

# PET1600-12-074NA

## AC-DC Front-End Power Supply

The PET1600-12-074NA is a 1600 Watt AC to DC, power-factor-corrected (PFC) power supply that converts standard AC power into a main output of +12 VDC for powering intermediate bus architectures (IBA) in high performance and reliability servers, routers, and network switches.

The PET1600-12-074NA utilizes full digital control architecture for greater efficiency, control, and functionality.

This power supply meets international safety standards and displays the CE-Mark for the European Low Voltage Directive (LVD).



### Key Features & Benefits

- Best-in-Class, 80 PLUS Certified “Platinum” Efficiency
- Auto-Selected Input Voltage Ranges: 90-140VAC, 180-264 VAC
- AC Input with Power Factor Correction
- 1600 W Continuous and 2100 W Peak Output Power Capability
- Always-On 12 V/3.5 A Standby Output
- Hot-plug Capable
- Parallel Operation with Active Current Sharing
- Full Digital Controls for Improved Performance
- High Density Design: 33.7 W/in<sup>3</sup>
- Small Form Factor: 265 x 73.5 x 40 mm (10.43 x 2.89 x 1.57 in)
- Power Management Bus Communication Protocol for Control Programming and Monitoring
- Status LED with Fault Signaling

### Applications

- Networking Switches
- Servers & Routers
- Telecommunications



**bel** POWER  
SOLUTIONS &  
PROTECTION

a bel group

[belfuse.com/power-solutions](http://belfuse.com/power-solutions)

## 1. ORDERING INFORMATION

PET	1600	-	12	-	074	N	A
Product Family	Power Level	Dash	V1 Output	Dash	Width	Airflow	Input
PET Front-Ends	1600 W		12 V		74 mm	N: Normal	A: AC

## 2. OVERVIEW

The PET1600-12-074NA AC/DC power supply is a fully DSP controlled, highly efficient front-end power supply. It incorporates resonance-soft-switching technology to reduce component stresses, providing increased system reliability and very high efficiency. With a wide input operational voltage range the PET1600-12-074NA maximizes power availability in demanding server, network, and other high availability applications. The supply is fan cooled and ideally suited for integration with a matching airflow path.

The PFC stage is digitally controlled using a state-of-the-art digital signal processing algorithm to guarantee best efficiency and unity power factor over a wide operating range.

The DC/DC stage uses soft switching resonant techniques in conjunction with synchronous rectification. An active OR-ing device on the output ensures no reverse load current and renders the supply suitable for operation in redundant power systems.

The always-on standby output provides power to external power distribution and management controllers. It is protected with an active OR-ing device for maximum reliability.

Status information is provided with a front-panel LED. In addition, the power supply can be controlled and the fan speed set via the I2C bus. The I2C bus allows full monitoring of the supply, including input and output voltage, current, power, and inside temperatures. Cooling is managed by a fan controlled by the DSP controller. The fan speed is adjusted automatically depending on the actual power demand and supply temperature and can be overridden through the I2C bus.

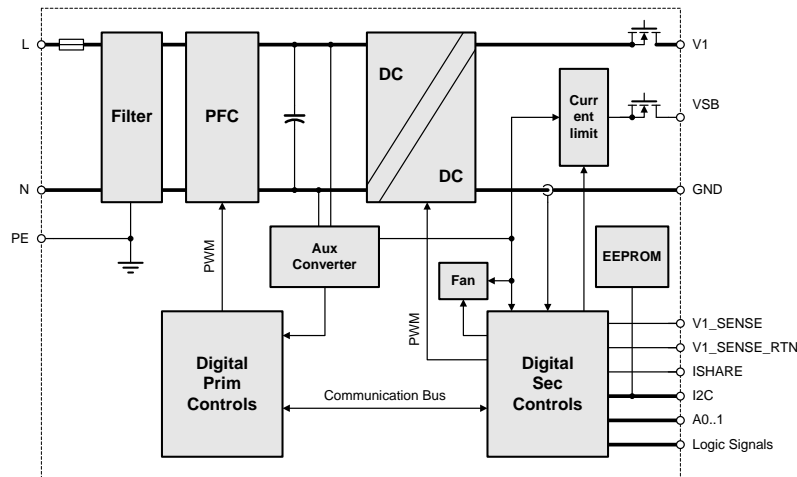


Figure 1. PET1600-12-074NA Block Diagram

## 3. ABSOLUTE MAXIMUM RATINGS

Stresses in excess of the absolute maximum ratings may cause performance degradation, adversely affect long-term reliability and cause permanent damage to the supply.

PARAMETER	CONDITIONS / DESCRIPTION	MIN	MAX	UNITS
$V_i maxc$	Maximum Input	Continuous	264	VAC

## 4. INPUT

General Condition:  $T_A = 0 \dots 55 \text{ }^\circ\text{C}$ ,  $V_i = 230 \text{ VAC}$  unless otherwise noted.

PARAMETER		DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
$V_{i\,nom}$	Nominal Input Voltage	Rated Voltage High Line ( $V_{i\,nom\,HL}$ )	200	230	240	VAC
		Rated Voltage Low Line ( $V_{i\,nom\,LL}$ )	100	115	127	VAC
$V_i$	Input Voltage Ranges	Normal operating ( $V_{i\,min\,HL}$ to $V_{i\,max\,HL}$ ), High Line	180		264	VAC
		Normal operating ( $V_{i\,min\,LL}$ to $V_{i\,max\,LL}$ ), Low Line	90		140	VAC
$I_{i\,max}$	Maximum Input Current	$V_{IN}$ = 100 VAC, 100% load			13	A <sub>RMS</sub>
$I_{i\,inrush}$	Inrush Current Limitation	$V_{i\,min}$ to $V_{i\,max}$ , $T_{NTC}$ = 25°C, 5 ms			10	A <sub>p</sub>
$f_i$	Input Frequency		47	50/60	63	Hz
$PF$	Power Factor	10% Load	0.8	0.88		W/VA
		20% Load	0.9	0.95		W/VA
		50% Load	0.9	0.997		W/VA
		100% Load	0.95	0.999		W/VA
$THD$	Total Harmonic Distortion	TBD			TBD	%
$V_{i\,on}$	Turn-on Input Voltage <sup>1</sup>	Ramping up	87		90	VAC
$V_{i\,off}$	Turn-off Input Voltage <sup>1</sup>	Ramping down	82		87	VAC
$\eta$	Efficiency <sup>2</sup>	$V_{IN}$ = 230 VAC, 10% load	82	90.8		%
		$V_{IN}$ = 230 VAC, 20% load	90	93.5		%
		$V_{IN}$ = 230 VAC, 50% load	94	94.4		%
		$V_{IN}$ = 230 VAC, 100% load	91	93.0		%
$T_{V1\,holdup}$	Hold-up Time $V_i$	$V_{IN}$ = 230 VAC, 50% load		20		ms
		$V_{IN}$ = 230 VAC, 75% load		13		ms
		$V_{IN}$ = 230 VAC, 100% load		9		ms
		$V_{IN}$ = 110 VAC, 100% load		17		ms
$T_{VSB\,holdup}$	Hold-up Time $V_{SB}$	12 $V_{SB}$ , full load	70			ms

### 4.1 INPUT FUSE

Time-lag 16 A input fuse (5 x 20 mm) in series with the L-line inside the power supply protects against severe defects. The fuse is not accessible from the outside and is therefore not a serviceable part.

### 4.2 INRUSH CURRENT

The AC-DC power supply exhibits an X capacitance of only 5.9  $\mu\text{F}$ , resulting in a low and short peak current, when the supply is connected to the mains. The internal bulk capacitor will be charged through an NTC which will limit the inrush current.

#### NOTE:

Do not repeat plug-in / out operations within a short time, or else the internal in-rush current limiting device (NTC) may not sufficiently cool down and excessive inrush current or component failure(s) may result.

<sup>1</sup> The Front-End is provided with a minimum hysteresis of 3 V during turn-on and turn-off within the ranges

<sup>2</sup> Efficiency measured without fan power per EPA server guidelines

### 4.3 INPUT UNDER-VOLTAGE

If the sinusoidal input voltage stays below the input under voltage lockout threshold  $V_{i on}$ , the supply will be inhibited. Once the input voltage returns within the normal operating range, the supply will return to normal operation again.

### 4.4 POWER FACTOR CORRECTION

Power factor correction (PFC) is achieved by controlling the input current waveform synchronously with the input voltage. A fully digital controller is implemented giving outstanding PFC results over a wide input voltage and load ranges. The input current will follow the shape of the input voltage. If for instance the input voltage has a trapezoidal waveform, then the current will also show a trapezoidal waveform.

### 4.5 EFFICIENCY

High efficiency (see [Figure 2](#)) is achieved by using state-of-the-art silicon power devices in conjunction with soft-transition topologies minimizing switching losses and a full digital control scheme. Synchronous rectifiers on the output reduce the losses in the high current output path. The speed of the fan is digitally controlled to keep all components at an optimal operating temperature regardless of the ambient temperature and load conditions.

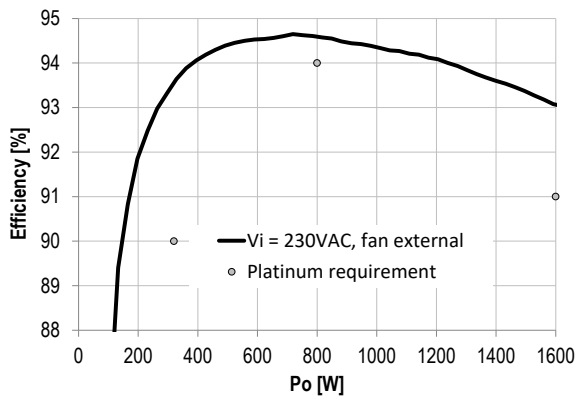


Figure 2. Efficiency vs. Load current (ratio metric loading)

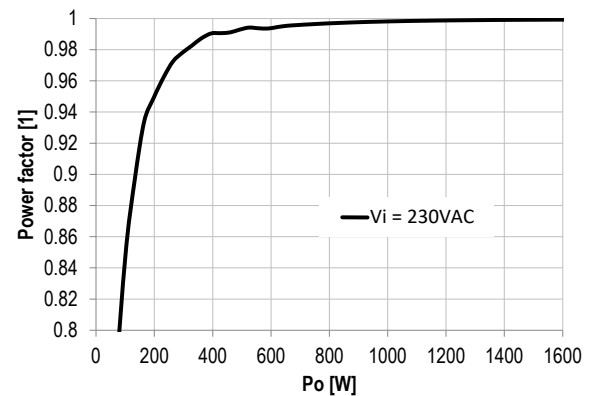


Figure 3. Power factor vs. Load current

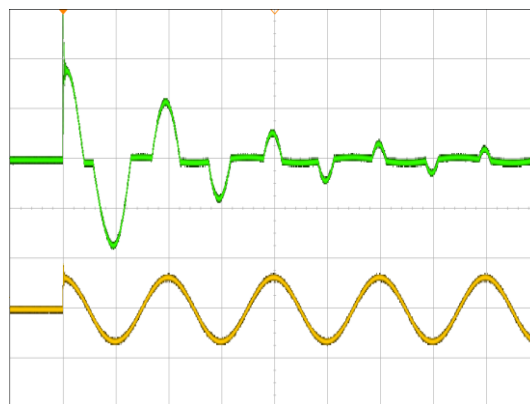


Figure 4. Inrush current,  $V_{in} = 230 \text{ Vac}$ ,  $90^\circ$   
CH1:  $V_{in}$  (500 V/div), CH2:  $I_{in}$  (10 A/div)

## 5. OUTPUT

### 5.1 MAIN OUTPUT $V_1$

General Condition:  $T_A = 0 \dots 55^\circ\text{C}$ ,  $V_i = 230\text{ VAC}$  unless otherwise noted.

PARAMETER		DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
$V_{1\text{ nom}}$	Nominal Output Voltage	$0.5\ I_{1\text{ nom}},\ T_A = 25^{\circ}\text{C}$		12.0		VDC
$V_{1\text{ set}}$	Output Setpoint Accuracy		-0.5		+0.5	% $V_{1\text{ nom}}$
$dV_{1\text{ tot}}$	Static Regulation	$V_{1\text{ min}}$ to $V_{1\text{ max}}$ , 0 to 100% $I_{1\text{ nom}}$	-1		+1	% $V_{1\text{ nom}}$
$P_{1\text{ nom}}$	Nominal Output Power	$V_{1\text{ min HL}}$ to $V_{1\text{ max HL}}$		1600		W
		$V_{1\text{ min LL}}$ to $V_{1\text{ max LL}}$		1000		W
$P_{1\text{ peak}}$	Peak Output Power <sup>3</sup>	$V_{1\text{ min HL}}$ to $V_{1\text{ max HL}}$		2100		W
		$V_{1\text{ min LL}}$ to $V_{1\text{ max LL}}$		1320		W
$I_{1\text{ nom}}$	Output Current	$V_{1\text{ min HL}}$ to $V_{1\text{ max HL}}$	0.0		133	ADC
$I_{1\text{ nom red}}$		$V_{1\text{ min LL}}$ to $V_{1\text{ max LL}}$	0.0		83	ADC
$I_{1\text{ peak}}$	Peak Output Current <sup>3</sup>	$V_{1\text{ min HL}}$ to $V_{1\text{ max HL}}$	0.0		175	ADC
$I_{1\text{ peak red}}$		$V_{1\text{ min LL}}$ to $V_{1\text{ max LL}}$	0.0		110	ADC
$V_{1\text{ pp}}$	Output Ripple Voltage <sup>4</sup>	$V_{1\text{ min}}$ to $V_{1\text{ max}}$ , 0 to 75% $I_{1\text{ nom}},\ C_{\text{ext}} = 0\text{ mF}$			120	mVpp
		$V_{1\text{ min}}$ to $V_{1\text{ max}}$ , 75 to 100% $I_{1\text{ nom}},\ C_{\text{ext}} = 0\text{ mF}$			150	mVpp
		$V_{1\text{ min LL}}$ to $V_{1\text{ max HL}}$ , 0 to 100% $I_{1\text{ nom}},\ C_{\text{ext}} \geq 1\text{ mF/Low ESR}$			120	mVpp
$dV_{1\text{ load}}$	Load Regulation	$V_{1\text{ nom HL}}$ , 0 to 100% $I_{1\text{ nom}}$	-67	-89	-111	mV
$dV_{1\text{ line}}$	Line Regulation	$V_{1\text{ min}}$ to $V_{1\text{ max}}$ , $0.5 \cdot I_{1\text{ nom}}$	-24	0	24	mV
$dV_{1\text{ temp}}$	Thermal Drift	$0.5 \cdot I_{1\text{ nom}},\ T_A = 0 \dots 55^{\circ}\text{C}$			TBD	%/ $^{\circ}\text{C}$
$dI_{1\text{ share}}$	Current Sharing	Difference between individual $I_1$ , 0 ... 8 power supplies in parallel	-8		+8	ADC
$V_{1\text{ SHARE}}$	Current Share Bus Voltage	$I_{1\text{ peak}}$		9.14		VDC
$dV_{1\text{ lt}}$	Load Transient Response	$\Delta I_1 = 50\%\ I_{1\text{ nom}},\ I_1 = 5 \dots 100\%\ I_{1\text{ nom}},\ C_{\text{ext}} = 0\text{ mF}$		0.35	0.6	VDC
$dV_{1\text{ lt}}$		$\Delta I_1 = 10\%\ I_{1\text{ nom}},\ I_1 = 0 \dots 10\%\ I_{1\text{ nom}},\ C_{\text{ext}} = 0\text{ mF}$		0.35	0.6	VDC
$t_{\text{rec}}$	Recovery Time	$dI/dt = 1\text{ A}/\mu\text{s}$ , recovery within 1% of $V_{1\text{ nom}}$		0.5	1	ms
$V_{1\text{ dyn}}$	Dynamic Load Regulation	$\Delta I_1 = 60\%\ I_{1\text{ nom}},\ I_1 = 5 \dots 133\text{ A},\ f = 50 \dots 5000\text{ Hz},$ Duty cycle = 10 ... 90%, $C_{\text{ext}} = 2 \dots 30\text{ mF}$	11.4		12.6	V
$t_{V1\text{ rise}}$	Output Voltage Rise Time	$V_1 = 10\ldots 90\%\ V_{1\text{ nom}}$ , external capacitance < 10 mF	0.5		30	ms
$t_{V1\text{ ovr sh}}$	Output Turn-on Overshoot	$V_{1\text{ nom HL}}$ , 0 to 100% $I_{1\text{ nom}}$			12.6	V
$dV_{1\text{ sense}}$	Remote Sense	Compensation for cable drop, 0 to 100% $I_{1\text{ nom}}$			0.25	V
$CV_{1\text{ load}}$	Capacitive Loading		0		25	mF

<sup>3</sup> Peak combined power for all outputs does not exceed 2100 W; maximum of peak power duration is 20 seconds without asserting the SMB Alert signal.

<sup>4</sup> Measured with a 10  $\mu\text{F}$  low ESR capacitor in parallel with a 0.1  $\mu\text{F}$  ceramic capacitor at the point of measurement.

## 5.2 STANBY OUTPUT $V_{SB}$

General Condition:  $T_A = 0 \dots 55^\circ\text{C}$ ,  $V_i = 230\text{ VAC}$  unless otherwise noted.

PARAMETER	DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
$V_{SB\text{ nom}}$	Nominal Output Voltage		12.15		VDC
$V_{SB\text{ set}}$	Output Setpoint Accuracy	-1		+1	$\%V_{SB\text{ nom}}$
$dV_{SB\text{ tot}}$	Total Regulation	-5		+1	$\%V_{SB\text{ nom}}$
$P_{SB\text{ nom}}$	Nominal output power		42		W
$P_{SB\text{ peak}}$	Peak Output Power <sup>5</sup>		48		W
$I_{SB\text{ nom}}$	Output Current	0.0		3.5	ADC
$I_{SB\text{ peak}}$	Peak Output Current <sup>5</sup>	0.0		4	ADC
$V_{SB\text{ pp}}$	Output Ripple Voltage <sup>4</sup>			120	mVpp
$dV_{SB\text{ load}}$	Load Regulation	-200	-300	-400	mV
$dV_{SB\text{ line}}$	Line Regulation	-24	0	24	mV
$dV_{SB\text{ temp}}$	Thermal Drift		-0.5		$\%^\circ\text{C}$
$dI_{SB\text{ share}}$	Current Sharing	-1		+1	ADC
$dV_{SB\text{ dyn}}$	Load Transient Response		0.2	0.3	VDC
$t_{\text{rec}}$	Recovery Time		1	2	ms
$V_{SB\text{ dyn}}$	Dynamic Load Regulation	11.4		12.6	V
$t_{V_{SB}\text{ rise}}$	Output Voltage Rise Time	1	2	5	ms
$t_{V_{SB}\text{ ovr sh}}$	Output Turn-on Overshoot			12.60	V
$C_{V_{SB}\text{ load}}$	Capacitive Loading	0		3100	$\mu\text{F}$

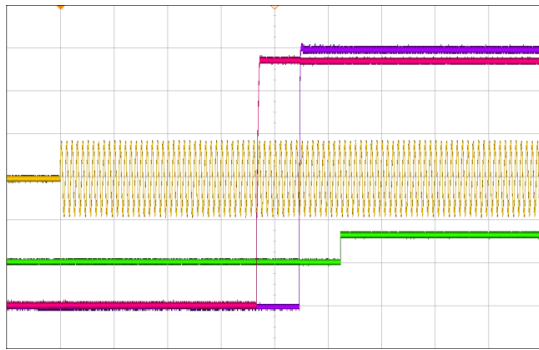


Figure 5. Turn-On AC Line 230 VAC, full load (200 ms/div)  
 CH1:  $V_{in}$  (400 V/div) CH2: PWOK\_H (5 V/div)  
 CH3:  $V_i$  (2 V/div) CH4:  $V_{SB}$  (2 V/div)

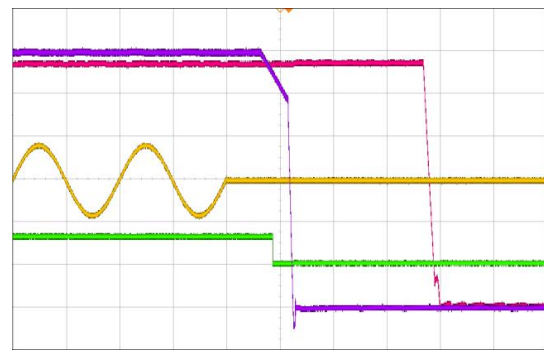


Figure 6 - Turn-Off AC Line 230 VAC, full load (10 ms/div)  
 CH1:  $V_{in}$  (400 V/div) CH2: PWOK\_H (5 V/div)  
 CH3:  $V_i$  (2 V/div) CH4:  $V_{SB}$  (2 V/div)

<sup>5</sup> In single power supply configuration.

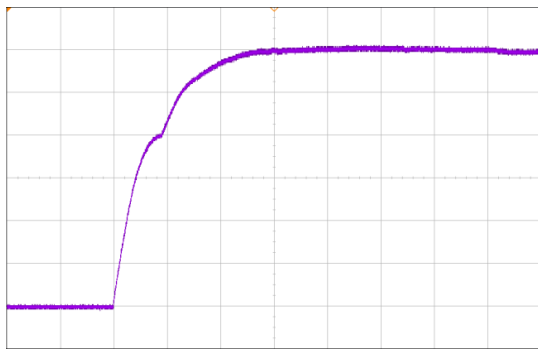


Figure 7. Turn-On AC Line 230 VAC, full load (2 ms/div)  
CH3:  $V_1$  (2 V/div)

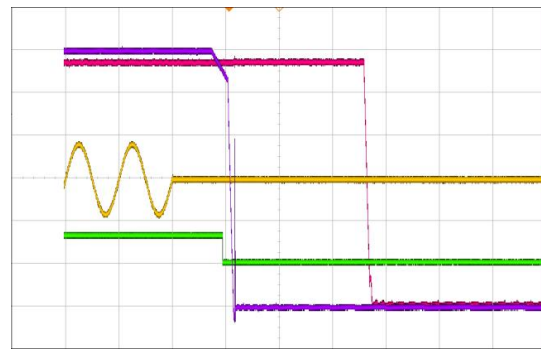


Figure 8. Turn-Off AC Line 230 VAC, half load (20 ms/div)  
CH1:  $V_{in}$  (400 V/div) CH2:  $PWOK\_H$  (5 V/div)  
CH3:  $V_1$  (2 V/div) CH4:  $V_{SB}$  (2 V/div)

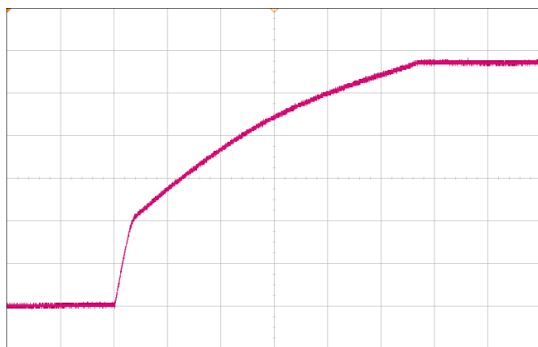


Figure 9. Turn-On AC Line 230 VAC, full load (2 ms/div)  
CH4:  $V_{SB}$  (2 V/div)

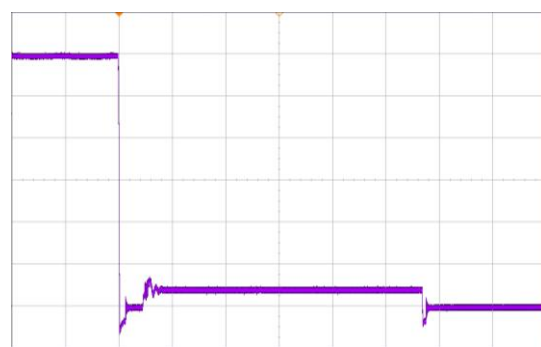


Figure 10. Short circuit on  $V_1$  (10 ms/Div)  
CH3:  $V_1$  (2 V/div)

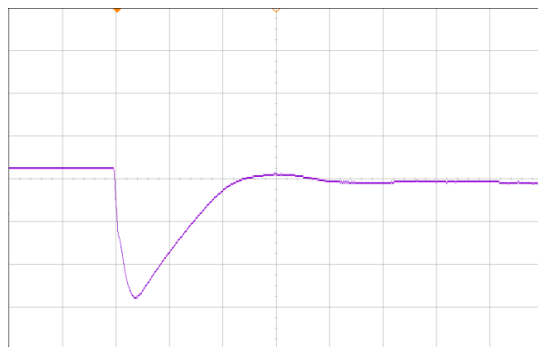


Figure 11. Load transient  $V_1$ , 133A to 67A (1 ms/div)  
CH3:  $V_1$  (2 V/div) CH4:  $V_{SB}$  (2 V/div)

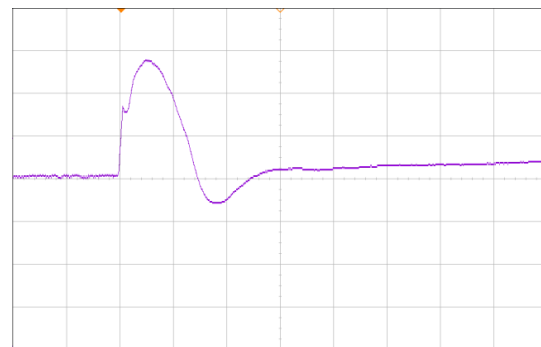


Figure 12. Load transient  $V_1$ , 67 A to 133 A (1 ms/div)  
CH3:  $V_1$  (200 mV/div)

### 5.3 OUTPUT GROUND / CHASSIS CONNECTION

The output return path serves as power and signal ground. All output voltages and signals are referenced to these pins. To prevent a shift in signal and voltage levels due to ground wiring voltage drop a low impedance ground plane should be used as shown in [Figure 13](#). Alternatively, separated ground signals can be used as shown in [Figure 14](#). In this case the two ground planes should be connected together at the power supplies ground pins.

**NOTE:**

Within the power supply the output GND pins are connected to the Chassis, which in turn is connected to the Protective Earth terminal on the AC inlet. Therefore, it is not possible to set the potential of the output return (GND) to any other than Protective Earth potential.

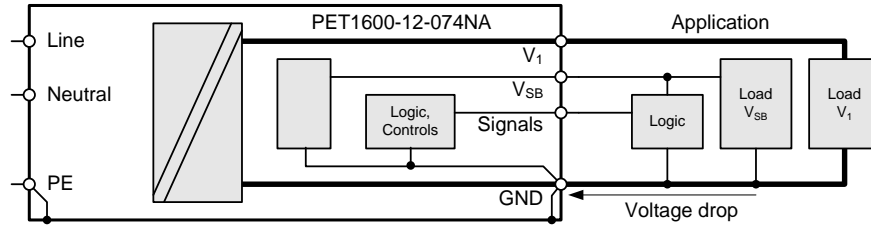


Figure 13. Common low impedance ground plane

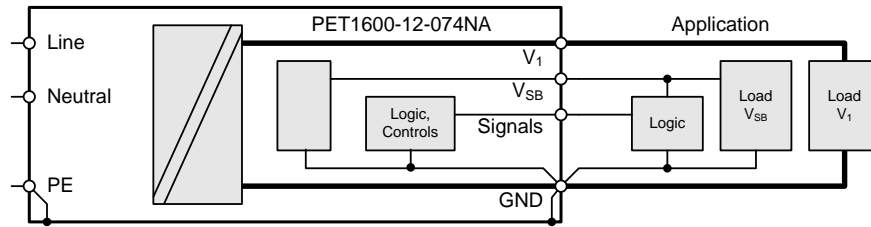


Figure 14. Separated power and signal ground

## 6. PROTECTION

PARAMETER	DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
$F$	Input fuse (L)	Not use accessible, time-lag (T)			A
$V_1 OV$	OV Threshold $V_1$	13.3	13.9	14.5	VDC
$t_{V1 OV}$	OV Trip Time $V_1$	Over Voltage $V_1$ Protection, Latch-off Type			ms
$V_{VSB OV}$	OV Threshold $V_{SB}$	13.3	13.9	14.5	VDC
$t_{VSB OV}$	OV Trip Time $V_{SB}$	Over Voltage $V_1$ Protection, Automatic retry each 1s			ms
$I_{V1 OC Slow}$	OC Limit $V_1$	Over Current Limitation, Latch-off, $V_{1 min HL}$ to $V_{1 max HL}$			ADC
		Over Current Limitation, Latch-off, $V_{1 min LL}$ to $V_{1 max LL}$			ADC
$t_{V1 OC Slow}$	OC Trip time $V_1$	20			s
$I_{V1 OC Fast}$	Fast OC Limit $V_1$	Fast Over Current Limit., Latch-off, $V_{1 min HL}$ to $V_{1 max HL}$			ADC
		Fast Over Current Limit., Latch-off, $V_{1 min LL}$ to $V_{1 max LL}$			ADC
$t_{V1 OC Fast}$	Fast OC Trip time $V_1$	50		60	ms
$I_{V1 SC}$	Max Short Circuit Current $V_1$	$V_1 < 3 V$			A
$t_{V1 SC}$	Short Circuit Regulation Time	$V_1 < 3 V$ , time until $I_{V1}$ is limited to $< I_{V1 SC}$			ms
$I_{VSB OC}$	OC Limit $V_{SB}$	4.1	4.5	4.9	A
$t_{VSB OC}$	OC Trip time $V_{SB}$	Over Current Limit., time until $I_{VSB}$ is limited to $I_{VSB OC}$			ms
$T_{SD}$	Over Temperature On Heat Sinks	See chapter 10.2			°C



## 6.1 OVERVOLTAGE PROTECTION

The PET1600-12-074NA front-end provides a fixed threshold overvoltage (OV) protection implemented with a HW comparator for both the main and the standby output. Once an OV condition has been triggered on the main output, the supply will shut down and latch the fault condition. The latch can be unlocked by disconnecting the supply from the AC mains or by toggling the PSON\_L input. The standby output will continuously try to restart with a 1 s interval after OV condition has occurred.

## 6.2 UNDERVOLTAGE DETECTION

Both main and standby outputs are monitored. LED and PWOK\_H pin signal if the output voltage exceeds  $\pm 5\%$  of its nominal voltage.

The main output will latch off if the main output voltage  $V_1$  falls below 10 V (typically in an overload condition) for more than 55 ms. The latch can be unlocked by disconnecting the supply from the AC mains or by toggling the PSON\_L input.

If the standby output leaves its regulation bandwidth for more than 2 ms then the main output is disabled to protect the system.

## 6.3 CURRENT LIMITATION

### MAIN OUTPUT

The main output exhibits a substantially rectangular output characteristic controlled by a software feedback loop. If output current exceeds  $I_{V1\ OC\ Fast}$  it will reduce output voltage in order to keep output current at  $I_{V1\ OC\ Fast}$ . If the output voltage drops below  $\sim 10.0$  VDC for more than 55 ms, the output will latch off (standby remains on), see also [Undervoltage Detection](#).

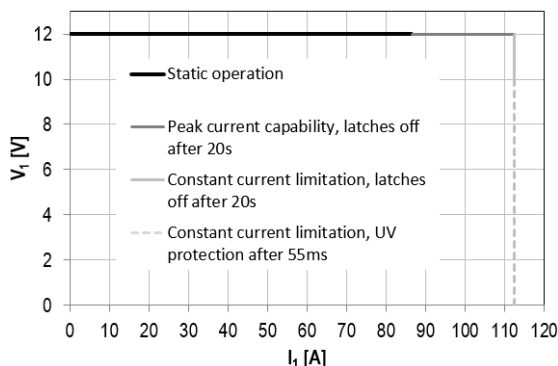


Figure 15. Current Limitation on  $V_1$  at  $V_i = 90 \dots 140$  VAC

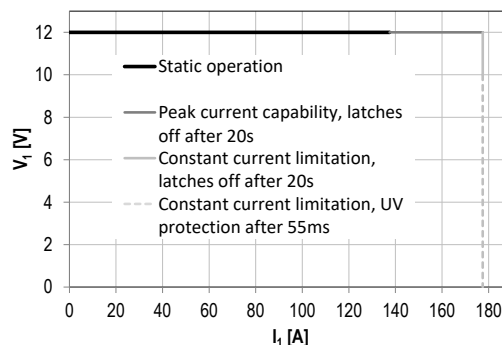


Figure 16. Current Limitation on  $V_1$  at  $V_i = 180 \dots 264$  VAC

A second SW controlled current limit will latch off the main output if the power supply is operated for long duration in its peak current capability region. This protection trips as soon as the output current exceeds  $I_{V1\ OC\ Slow}$  for duration of more than 20 s. The third current limitation implemented as a fast hardware circuit will immediately switch off the main output if the output current increases beyond the peak current trip point, occurring mainly if a short circuit is applied to the output voltage. The supply will re-start 4 ms later with a soft start, if the short circuit persists ( $V_1 < 10.0$  V for  $> 55$  ms) the output will latch off; otherwise it continues to operate.


The latch can be unlocked by disconnecting the supply from the AC mains or by toggling the PSON\_L input.

The main output current limitation thresholds for  $I_{V1\ OC\ Slow}$  and  $I_{V1\ OC\ Fast}$  depend on the actual input voltage range applied to the power supply. In addition, the threshold for  $I_{V1\ OC\ Slow}$  is reduced when ambient temperature exceeds  $55^\circ\text{C}$ , see Error! Reference source not found..

### STANDBY OUTPUT

The standby output exhibits a substantially rectangular output characteristic down to 0 V (no hiccup mode / latch off). The current limitation of the standby output is independent of the AC input voltage.

Running in current limitation causes the output voltage to fall, this will trigger under voltage protection and disables the main output, see also [Undervoltage Detection](#).

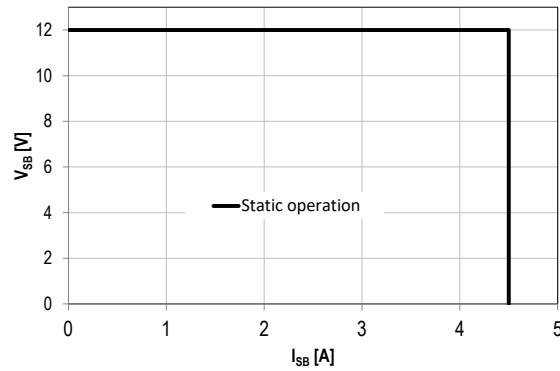Figure 17. Current Limitation on  $V_{SB}$ 

## 7. MONITORING

The power supply operating parameters can be accessed through I<sup>2</sup>C interface. For more details refer to chapter *I<sup>2</sup>C / POWER MANAGEMENT BUS COMMUNICATION* and document URP.00234 (PET2000-12-074NA Power Management Bus Communication Manual).

PARAMETER		DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
$V_{I\ mon}$	Input RMS Voltage	$V_{I\ min\ LL} \leq V_I \leq V_{I\ max\ HL}$	-2		+2	VAC
$I_{I\ mon}$	Input RMS Current	$I_I > 6.7\ A_{rms}$	-3		+3	%
		$I_I \leq 6.7\ A_{rms}$	-0.2		+0.2	$A_{rms}$
$P_{I\ mon}$	True Input Power	$P_I > 250\ W$	-4		+4	%
		$P_I < 250\ W$	-10		+10	W
$V_{I\ mon}$	$V_I$ Voltage		-0.1		+0.1	VDC
$I_{I\ mon}$	$V_I$ Current	$I_I > 25\ A$	-1		+1	%
		$I_I \leq 25\ A$	-0.25		+0.25	ADC
$P_{I\ nom}$	$V_I$ Output Power	$P_I > 250\ W$	-2		+2	%
		$P_I < 250\ W$	-5		+5	W
$V_{SB\ mon}$	$V_{SB}$ Voltage		-0.1		+0.1	VDC
$I_{SB\ mon}$	$V_{SB}$ Current		-0.1		+0.1	ADC
$T_{A\ mon}$	Inlet Temperature	$T_{A\ min} \leq T_A \leq T_{A\ max}$	-2		+2	°C

## 8. SIGNALING AND CONTROL

### 8.1 ELECTRICAL CHARACTERISTICS

PARAMETER	DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
<b>PSON_H / HOTSTANDBYEN_L</b>					
$V_{IL}$	Input Low Level Voltage PSON_L: Main output enabled HOTSTANDBYEN_H: Hot Standby mode not allowed	-0.2		0.8	V
$V_{IH}$	Input High Level Voltage PSON_L: Main output disabled HOTSTANDBYEN_H: Hot Standby mode allowed	2		3.5	V
$I_{IL,H}$	Maximum Input Sink or Source Current $V_I = -0.2\text{ V to }+3.5\text{ V}$	-1		1	mA
$R_{pull\ up}$	Internal Pull up Resistor to internal 3.3V		10		k $\Omega$
$R_{LOW}$	Maximum external Pull down Resistance to GND to obtain Low Level			1	k $\Omega$
$R_{HIGH}$	Minimum external Pull down Resistance to GND to obtain High Level	50			k $\Omega$
<b>PWOK_H</b>					
$V_{OL}$	Output Low Level Voltage $V_I < V_{i\ min\ LL}, V_{Isink} < 4\text{ mA}$	0		0.4	V
$V_{OH}$	Output High Level Voltage $V_I > V_{i\ min\ LL}, I_{source} < 0.5\text{ mA}$	2.4		3.5	V
$R_{pull\ up}$	Internal Pull up Resistor to internal 3.3V		1		k $\Omega$
$I_{OL}$	Maximum Sink Current $V_O < 0.4\text{ V}$			4	mA

### 8.2 SENSE INPUTS

The main output has sense lines implemented to compensate for voltage drop on load wires in both positive and negative path. The maximum allowed voltage drop is 200 mV on the positive rail and 50 mV on the GND rail.

With open sense inputs the main output voltage will rise by 270 mV. Therefore if not used, these inputs should be connected to the power output and GND at the power supply connector. The sense inputs are protected against short circuit. In this case the power supply will shut down.

### 8.3 CURRENT SHARE

The PET front-ends have an active current share scheme implemented for V1. All ISHARE pins need to be interconnected in order to activate the current sharing functionality. If a supply has an internal fault or is not turned on, it will disconnect its ISHARE pin from the share bus. This will prevent dragging the output down (or up) in such cases.

The current share function uses an analog bus to transmit and receive current share information. The controller implements a Master/Slave current share function. The power supply providing the largest current among the group is automatically the Master. The other supplies will operate as Slaves and increase their output current to a value close to the Master by slightly increasing their output voltage. The voltage increase is limited to +250 mV.

The standby output uses a passive current share method (droop output voltage characteristic).

### 8.4 PSON\_L INPUT

The PSON\_L is an internally pulled-up (3.3 V) input signal to enable/disable the main output V1 of the front-end. With low level input the main output is enabled. Toggling this active-low pin is also used to clear any latched fault condition. The PSON\_L can either be controlled by an open collector device or by a voltage source.

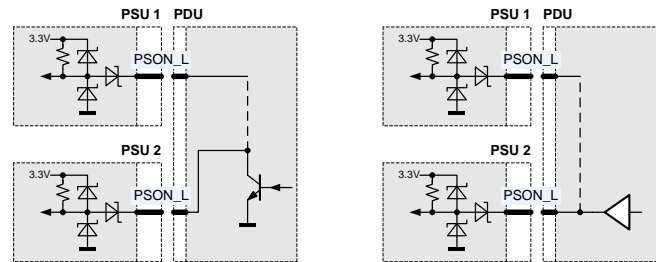


Figure 18. PS\_ON\_H connection

## 8.5 PWOK\_H OUTPUT

The PWOK\_H is an open drain output with an internal pull-up to 3.3 V indicating whether both VSB and V1 outputs are within regulation. This pin is active-low.

An external pull down resistor ensures low level when there is no power supply seated. When combining PWOK\_H outputs of several power supplies, circuits as shown in [Figure 19](#) should be used.

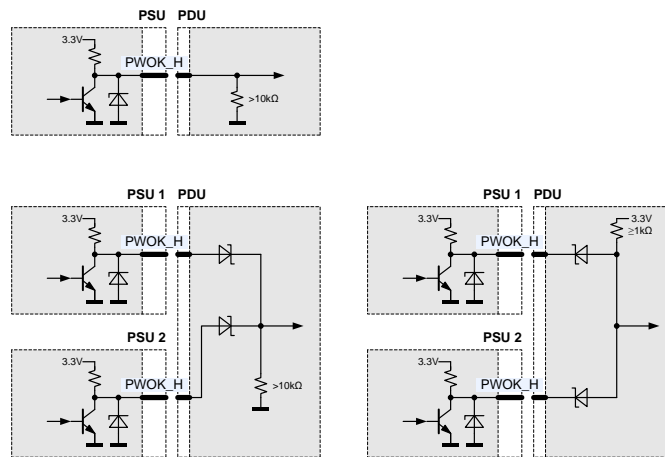


Figure 19. PWOK\_H connection

## 8.6 HOT-STANDBY IN-/OUTPUT

The hot-standby operation is an operating mode allowing to further increase efficiency at light load conditions in a redundant power supply system. Under specific conditions one of the power supplies is allowed to disable its DC/DC stage. This will save the power losses associated with this power supply and at the same time the other power supply will operate in a load range having a better efficiency. In order to enable the hot standby operation, the HOTSTANDBYEN\_H and the ISHARE pins need to be interconnected between the power supplies. A power supply will only be allowed to enter the hot-standby mode, when the HOTSTANDBYEN\_H pin is high, the load current is low (see [Figure 20](#)) and the supply was allowed to enter the hot-standby mode by the system controller via the appropriate I<sup>2</sup>C command (by default disabled). The system controller needs to ensure that only one of the power supplies is allowed to enter the hot-standby mode.

If a power supply is in a fault condition, it will pull low its active-high HOTSTANDBYEN\_H pin which indicates to the other power supply that it is not allowed to enter the hot-standby mode or that it needs to return to normal operation should it already have been in the hot-standby mode.

### NOTE:

The system controller needs to ensure that only one of the power supplies is allowed to enter the hot-standby mode.

[Figure 21](#) shows the achievable power loss savings when using the hot-standby mode operation. A total power loss reduction of approx. 10W is achievable.

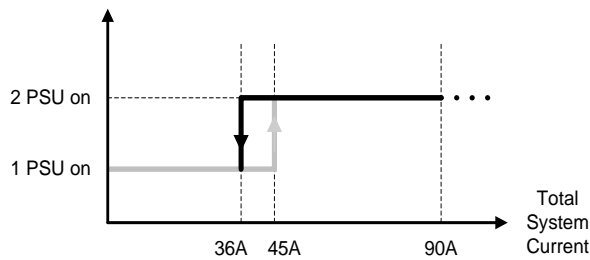


Figure 20. Hot-standby enable/disable current thresholds

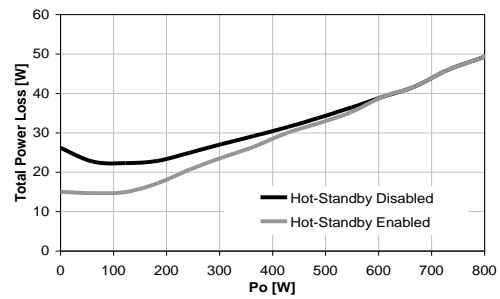


Figure 21. PSU power losses with/without hot-standby mode

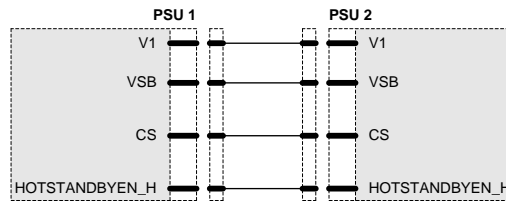


Figure 22. Recommended hot-standby configuration

## 8.7 PRESENT\_L OUTPUT - AVAILABLE ONLY ON VERSION PET1600-12-074NAS311

The PRESENT\_L pin is wired through a 100 Ohms resistor to internal GND within the power supply. This pin indicates that there is a power supply present in this system slot. An external pull-up resistor has to be added within the application. Current into the PRESENT\_L pin should not exceed 5 mA to guarantee a low level voltage if power supply is seated.

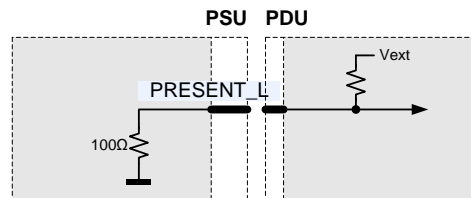


Figure 23. PRESENT\_L connection

## 8.8 SIGNAL TIMING

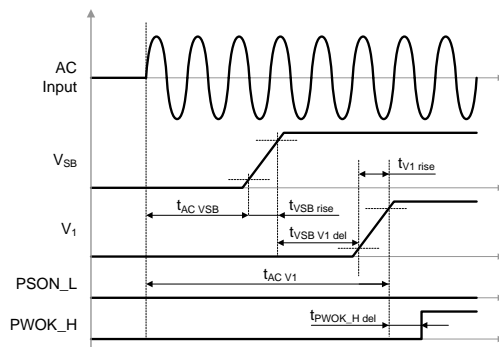


Figure 24. AC turn-on timing

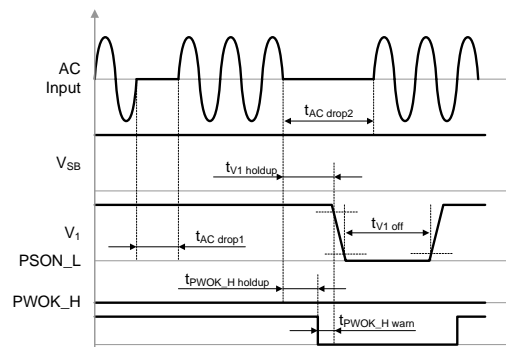


Figure 25. AC short dips

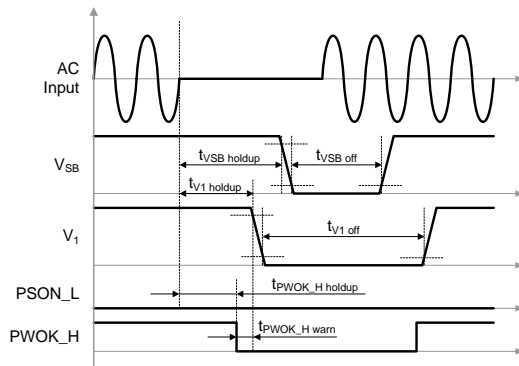


Figure 26. AC long dips

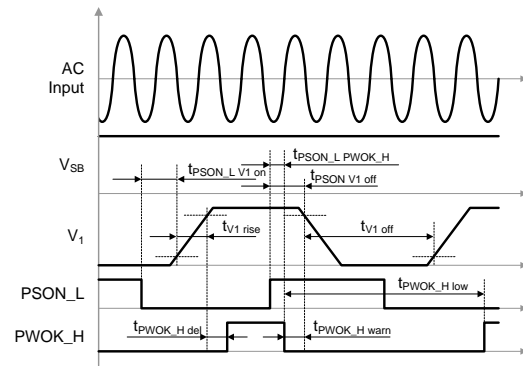


Figure 27. PS\_ON\_L turn-on/off timing

PARAMETER	DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
$t_{AC\ VSB}$	AC Line to 90% $V_{SB}$			3.5 <sup>6</sup>	s
$t_{AC\ V1}$	AC Line to 90% $V_1$			4 <sup>6</sup>	s
$t_{VSB\ V1\ del}$	$V_{SB}$ to $V_1$ delay	50	250	1000	ms
$t_{V1\ rise}$	$V_1$ rise time	See chapter <a href="#">Output</a>			
$t_{VSB\ rise}$	$V_{SB}$ rise time	See chapter <a href="#">Output</a>			
$t_{AC\ drop1}$	AC drop without $V_1$ leaving regulation	$I_1\ nom$ , $I_{SB\ nom}$			
$t_{AC\ drop2}$	AC drop without $V_{SB}$ leaving regulation	$I_1\ nom$ , $I_{SB\ nom}$			
$t_{V1\ holdup}$	Loss of AC to $V_1$ leaving regulation	See chapter <a href="#">Input</a>			
$t_{VSB\ holdup}$	Loss of AC to $V_1$ leaving regulation	See chapter <a href="#">Input</a>			
$t_{PWOK\_H\ del}$	Outputs in regulation to PWOK_H asserted	100	250	200	ms
$t_{PWOK\_H\ warn}$	Warning time from de-assertion of PWOK_H to $V_1$ leaving regulation	0.15			ms
$t_{PWOK\_H\ holdup}$	Loss of AC to PWOK_H de-asserted	10			ms
$t_{PWOK\_H\ low}$	Time PWOK_H is kept low after being de-asserted	100			ms
$t_{PS\_ON\_L\ V1\ on}$	Delay PS_ON_L active to $V_1$ in regulation	5	10	20	ms
$t_{PS\_ON\_L\ V1\ off}$	Delay PS_ON_L de-asserted to $V_1$ disabled	2	3	4	ms
$t_{PS\_ON\_L\ PWOK\_H}$	Delay PS_ON_L de-asserted to PWOK_H de-asserted		1	2	ms
$t_{V1\ off}$	Time $V_1$ is kept off after leaving regulation		1		s
$t_{VSB\ off}$	Time $V_{SB}$ is kept off after leaving regulation		1		s

<sup>6</sup> At repeated ON-OFF cycles the start-up time can be increased by 1s

## 8.9 LED INDICATOR

The front-end has one front LED showing the status of the supply. The LED is bi-colored: green and amber, and indicates AC and DC power presence and warning or fault conditions. [Table 1](#) lists the different LED status.

OPERATING CONDITION *	LED SIGNALING
No AC or AC Line in UV condition, $V_{SB}$ not present from paralleled power supplies	Off
PSO_N_L High Hot-Standby Mode	Blinking Green 1Hz
No AC or AC Line in UV condition, $V_{SB}$ present from paralleled power supplies $V_I$ or $V_{SB}$ out of regulation Over temperature shutdown Output over voltage shutdown ( $V_I$ or $V_{SB}$ ) Output over current shutdown ( $V_I$ or $V_{SB}$ ) Fan error (>15%)	Solid Amber
Over temperature warning Minor fan regulation error (>5%, <15%)	Blinking Amber 1Hz
Firmware boot loading in process	Blinking Green 2Hz
Outputs $V_I$ and $V_{SB}$ in regulation	Solid Green

\* The order of the criteria in the table corresponds to the testing precedence in the controller.

Table 1. LED Status

## 9. I<sup>2</sup>C / POWER MANAGEMENT BUS COMMUNICATION

The PET front-end is a communication Slave device only; it never initiates messages on the I<sup>2</sup>C/SMBus by itself. The communication bus voltage and timing is defined in [Table 2](#) and further characterized through:

- The SDA/SCL IOs use 3.3 V logic levels
- External pull-up resistors on SDA/SCL required for correct signal edges
- Full SMBus clock speed of 100 kbps
- Clock stretching limited to 1 ms
- SCL low time-out of >25 with recovery within 10 ms
- Recognizes any time Start/Stop bus conditions

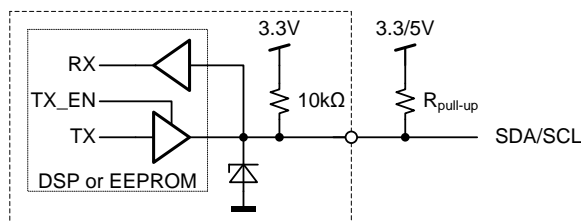


Figure 28. Physical layer of communication interface

Communication to the DSP or the EEPROM will be possible as long as the input AC voltage is provided. If no AC is present, communication to the unit is possible as long as it is connected to a life  $V_{SB}$  output (provided e.g. by a redundant unit). If only  $V_I$  is provided, communication is not possible.

PARAMETER	DESCRIPTION	CONDITION	MIN	MAX	UNIT
<b>SCL / SDA</b>					
$V_{IL}$	Input low voltage		-0.5	1.0	V
$V_{IH}$	Input high voltage		2.3	3.5	V
$V_{hys}$	Input hysteresis		0.15		V
$V_{OL}$	Output low voltage	3 mA sink current	0	0.4	V
$t_r$	Rise time for SDA and SCL		$20+0.1C_b^1$	300	ns
$t_{of}$	Output fall time $V_{IHmin} \rightarrow V_{ILmax}$	$10\text{ pF} < C_b^1 < 400\text{ pF}$	$20+0.1C_b^1$	250	ns
$I_i$	Input current SCL/SDA	$0.1\text{ VDD} < V_i < 0.9\text{ VDD}$	-10	10	$\mu\text{A}$
$C_i$	Internal Capacitance for each SCL/SDA			50	pF
$f_{SCL}$	SCL clock frequency		0	100	kHz
$R_{pull-up}$	External pull-up resistor	$f_{SCL} \leq 100\text{ kHz}$		$1000\text{ ns} / C_b^1$	$\Omega$
$t_{HSTA}$	Hold time (repeated) START	$f_{SCL} \leq 100\text{ kHz}$	4.0		$\mu\text{s}$
$t_{LOW}$	Low period of the SCL clock	$f_{SCL} \leq 100\text{ kHz}$	4.7		$\mu\text{s}$
$t_{HIGH}$	High period of the SCL clock	$f_{SCL} \leq 100\text{ kHz}$	4.0		$\mu\text{s}$
$t_{SUSTA}$	Setup time for a repeated START	$f_{SCL} \leq 100\text{ kHz}$	4.7		$\mu\text{s}$
$t_{HDDAT}$	Data hold time	$f_{SCL} \leq 100\text{ kHz}$	0	3.45	$\mu\text{s}$
$t_{SUDAT}$	Data setup time	$f_{SCL} \leq 100\text{ kHz}$	250		ns
$t_{SUSTO}$	Setup time for STOP condition	$f_{SCL} \leq 100\text{ kHz}$	4.0		$\mu\text{s}$
$t_{BUF}$	Bus free time between STOP and START	$f_{SCL} \leq 100\text{ kHz}$	5		ms

<sup>1</sup>  $C_b$  = Capacitance of bus line in pF, typically in the range of 10...400 pF

Table 2.  $I^2C$  / SMBus Specification

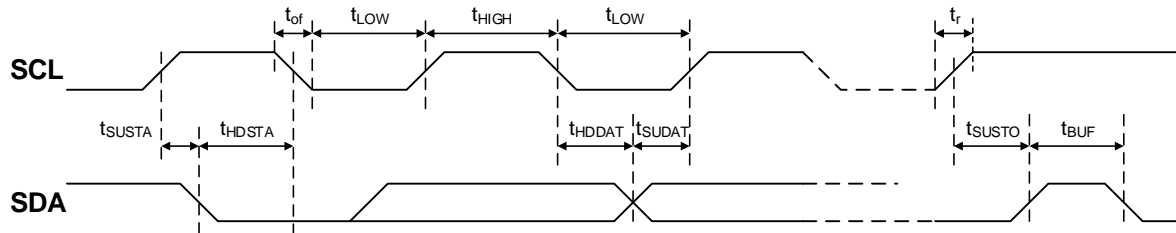


Figure 29.  $I^2C$  / SMBus Timing

## ADDRESS SELECTION

The address for  $I^2C$  communication can be configured by pulling address input pins A1 and A0 either to GND (logic low) or leave them open (logic high). An internal pull up resistor will cause the A1 / A0 pin to be in high level if left open. A fixed addressing offset exists between the Controller and the EEPROM.



A2 <sup>2)</sup>	A1	A0	I2C Address <sup>1)</sup>	
			Controller	EEPROM
0	0	0	0xB0	0xA0
0	0	1	0xB2	0xA2
0	1	0	0xB4	0xA4
0	1	1	0xB6	0xA6
1	0	0	0xB8	0xA8
1	0	1	0xBA	0xAA
1	1	0	0xBC	0xAC
1	1	1	0xBE	0xAE

<sup>1)</sup> The LSB of the address byte is the R/W bit.

<sup>2)</sup> A2 is available only on model PET1600-12-074NAS311. If it is not available, A2 = 0.

Table 3. Address and protocol encoding

## 9.1 SMBALERT\_L OUTPUT

The SMBALERT\_L signal indicates that the power supply is experiencing a problem that the system agent should investigate. This is a logical OR of the Shutdown and Warning events. It is asserted (pulled Low) at Shutdown or Warning events such as reaching temperature warning/shutdown threshold of critical component, general failure, over-current, over-voltage, under-voltage or low-speed of a failed fan. This signal may also indicate the power supply is operating in an environment exceeding the specified limits.

The SMBAlert signal is asserted simultaneously with the LED turning to solid amber or blinking amber.

PARAMETER	DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
<b>SMB_ALERT_L</b>					
$V_{ext}$	Maximum External Pull up Voltage			12	V
$I_{OH}$	Maximum High Level Leakage Current	No Failure or Warning condition, $V_O = 12\text{ V}$		10	$\mu\text{A}$
$V_{OL}$	Output Low Level Voltage	Failure or Warning condition, $I_{sink} < 4\text{ mA}$		0.4	V
$R_{pull\ up}$	Internal Pull up Resistor to internal 3.3 V			None	
$I_{OL}$	Maximum Sink Current	$V_O < 0.4\text{ V}$		4	mA

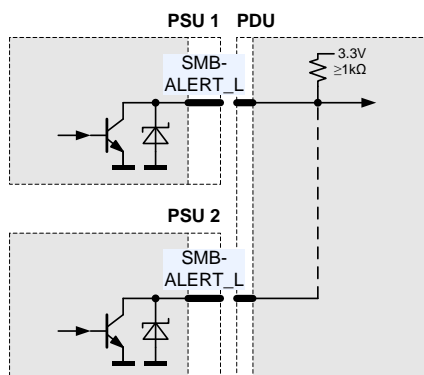


Figure 30. SMBALERT\_L connection

## 9.2 CONTROLLER AND EEPROM ACCESS

The controller and the EEPROM in the power supply share the same I<sup>2</sup>C bus physical layer (see *Figure 31*) and can be accessed under different addresses, see ADDRESS SELECTION.

The SDA/SCL lines are connected directly to the controller and EEPROM which are supplied by internal 3.3 V.

The EEPROM provides 256 bytes of user memory. None of the bytes are used for the operation of the power supply.

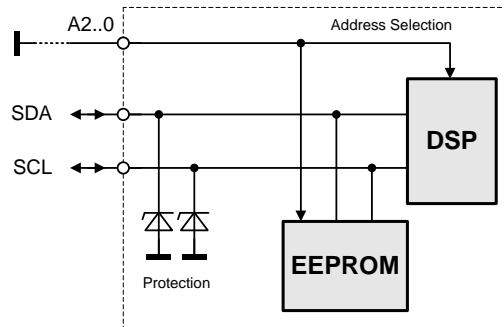


Figure 31. I<sup>2</sup>C Bus to DSP and EEPROM

## 9.3 EEPROM PROTOCOL

The EEPROM follows the industry communication protocols used for this type of device. Even though page write / read commands are defined, it is recommended to use the single byte write / read commands.


### WRITE

The write command follows the SMBus 1.1 Write Byte protocol. After the device address with the write bit cleared a first byte with the data address to write to is sent followed by the data byte and the STOP condition. A new START condition on the bus should only occur after 5ms of the last STOP condition to allow the EEPROM to write the data into its memory.



### READ

The read command follows the SMBus 1.1 Read Byte protocol. After the device address with the write bit cleared the data address byte is sent followed by a repeated start, the device address and the read bit set. The EEPROM will respond with the data byte at the specified location.



## 9.4 POWER MANAGEMENT BUS PROTOCOL


The Power Management Bus is an open standard protocol that defines means of communicating with power conversion and other devices. For more information, please see the System Management Interface Forum web site at [www.powerSIG.org](http://www.powerSIG.org).

Power Management Bus command codes are not register addresses. They describe a specific command to be executed. The PET1600-12-074NA supply supports the following basic command structures:


- Clock stretching limited to 1 ms
- SCL low time-out of >25 ms with recovery within 10 ms
- Recognized any time Start/Stop bus conditions

### WRITE

The write protocol is the SMBus 1.1 Write Byte/Word protocol. Note that the write protocol may end after the command byte or after the first data byte (Byte command) or then after sending 2 data bytes (Word command).

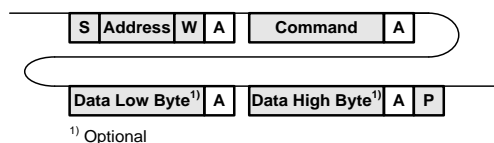


In addition, Block write commands are supported with a total maximum length of 255 bytes. See PET2000-12-074NA Power Management Bus Communication Manual URP.00234 for further information.




## READ

The read protocol is the SMBus 1.1 Read Byte/Word protocol. Note that the read protocol may request a single byte or word.

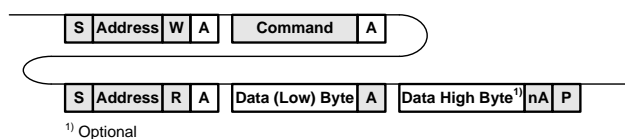

In addition, Block read commands are supported with a total maximum length of 255 bytes. See PET2000-12-074NA Power Management Bus Communication Manual URP.00234 for further information.



## 9.5 GRAPHICAL USER INTERFACE

Bel Power Solutions provides with its "I²C Utility" a Windows® XP/Vista/Win7 compatible graphical user interface allowing the programming and monitoring of the PET1600-12-074NA Front-End.

The utility can be downloaded from: [belfuse.com/power-solutions](http://belfuse.com/power-solutions) and supports both the PSMI and Power Management Bus protocols.

The GUI allows automatic discovery of the units connected to the communication bus and will show them in the navigation tree. In the monitoring view the power supply can be controlled and monitored.

If the GUI is used in conjunction with the YTM.00045 Evaluation Board it is also possible to control the PSON\_L pin(s) of the power supply.

### NOTE:

The user of the GUI needs to ensure that only one of the power supplies have the hot-standby mode enabled.

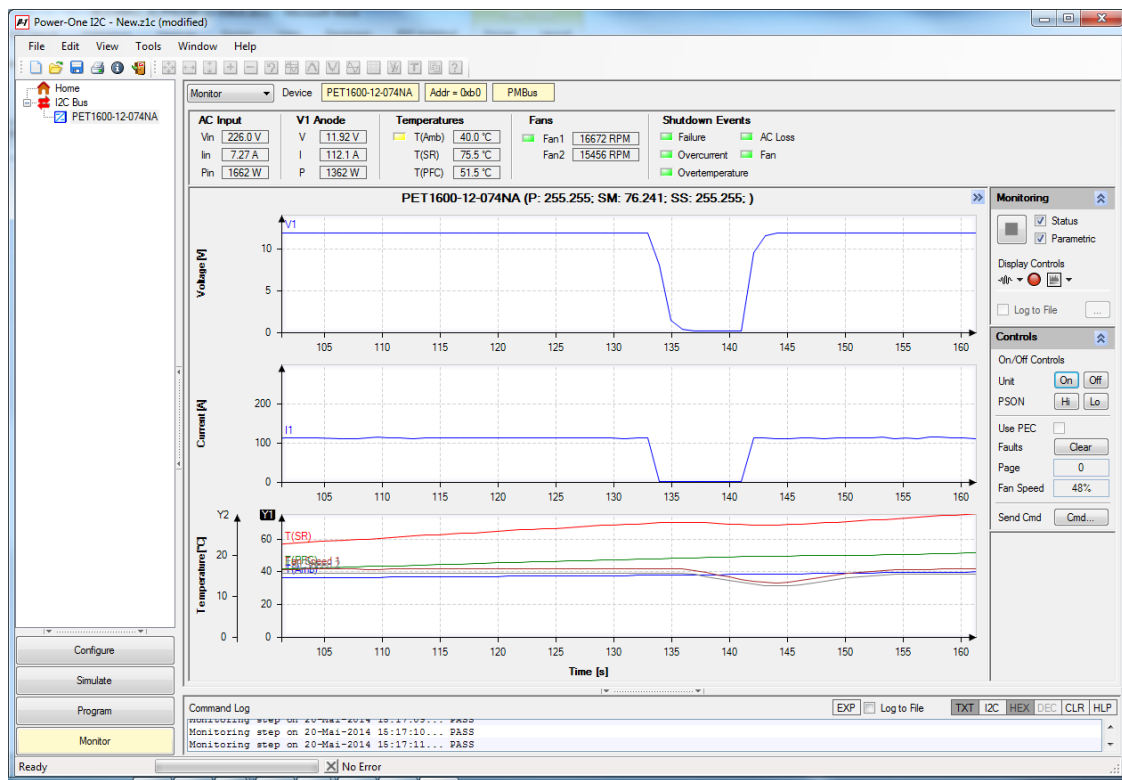


Figure 32. Monitoring dialog of the PC Utility

## 10. TEMPERATURE AND FAN CONTROL

### 10.1 FAN CONTROL

To achieve best cooling results sufficient airflow through the supply must be ensured. Do not block or obstruct the air-flow at the rear of the supply by placing large objects directly at the output connector. The PET1600-12-074NA is provided with a rear to front airflow, which means the air enters through the DC-output of the supply and leaves at the AC-inlet. The PET1600-12-074NA supply has been designed for horizontal operation.



Figure 33. Airflow direction

The fan inside the supply is controlled by a microprocessor. The rpm of the fan is adjusted to ensure optimal supply cooling and is a function of output power. Three different curves are selected based on input voltage and inlet temperature. With standby output loaded the fan speed minimum is limited to ensure enough cooling of circuits providing standby power. Figure 34 illustrates the programmed fan curves.

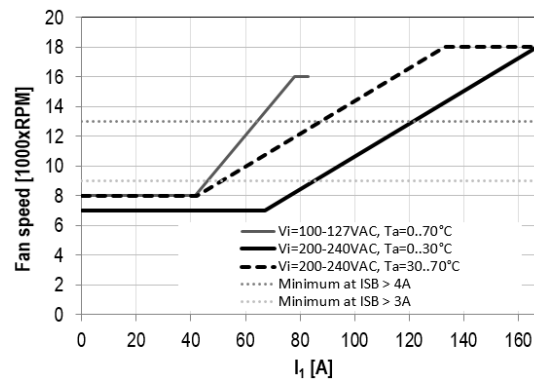


Figure 34. Fan speed vs. main output load

## 10.2 TEMPERATURE MONITOR AND OVER TEMPERATURE PROTECTION

The PET1600-12-074NA provides access via I<sup>2</sup>C to the measured temperatures of in total 6 sensors within the power supply, see [Table 4](#). The microprocessor is monitoring these temperatures and if warning threshold of one of these sensors is reached it will set fan to maximum speed. If temperatures continue to rise above shut down threshold the main output  $V_I$  (or  $V_{SB}$  if auxiliary converter is affected) will be disabled. At the same time the warning or fault condition is signaled accordingly through LED, PWOK\_H and SMBALERT\_L.

TEMPERATURE SENSOR	DESCRIPTION / CONDITION	POWER MANAGEMENT BUS REGISTER	WARNING THRESHOLD	SHUTDOWN THRESHOLD
Inlet air temperature	Sensor located on control board close to DC end of power supply	8Dh	73°C	78°C
Synchronous rectifier	Sensor located on secondary side of DC/DC stage	8Eh	95°C	100°C
Primary heat sink	Sensor located on primary heat sink	8Fh	87°C	92°C
Output ORing element	Sensor located close to output	D2h	100°C	105°C
Auxiliary converter	Sensor located on secondary side on auxiliary rectifier	D3h	80°C	85°C
Bridge rectifier	Sensor located on heat sink for AC rectifier	D4h	86°C	91°C

Table 4 – Temperature sensor location and thresholds

## 11. ELECTROMAGNETIC COMPATIBILITY

### 11.1 IMMUNITY

PARAMETER	DESCRIPTION / CONDITION	CRITERION
ESD Contact Discharge	IEC / EN 61000-4-2, ±8 kV, 25+25 discharges per test point (metallic case, LED, connector body)	A
ESD Air Discharge	IEC / EN 61000-4-2, ±15 kV, 25+25 discharges per test point (non-metallic user accessible surfaces)	A
Radiated Electromagnetics Filed	IEC / EN 61000-4-3, 10 V/m, 1 kHz/80% Amplitude Modulation, 1µs Pulse Modulation, 10 kHz ... 2 GHz	A
Burst	IEC / EN 61000-4-4, Level 3 AC port ±2 kV, 1 minute	A
Surge	IEC / EN 61000-4-5, Level 3 Line to Earth: ±2 kV Line to Line: ±1 kV	A
RF Conducted Immunity	IEC / EN 61000-4-6, Level 3, 10 Vrms, CW, 0.1 ... 80 MHz	A
Voltage Dips and Interruptions	IEC / EN 61000-4-11 1. $V_I$ 230VAC, 70% load, Phase 0°, Dip 100% , duration 10.6 ms 2. $V_I$ 230VAC, 70% load, Phase 0°, Dip 100% , duration 70 ms 3. $V_I$ 230VAC, 70% load, Phase 0°, Dip 100% , duration 100 ms	$V_I$ : A, $V_{SG}$ : A $V_I$ : B, $V_{SG}$ : A $V_I$ : B, $V_{SG}$ : B

## 11.2 EMISSION

PARAMETER	DESCRIPTION / CONDITION	CRITERION
Conducted Emission	EN 55022 / CISPR 22: 0.15 ... 30 MHz, QP and AVG, single power supply EN 55022 / CISPR 22: 0.15 ... 30 MHz, QP and AVG, 2 power supplies in a system	Class A 6 dB margin Class A
Radiated Emission	EN 55022 / CISPR 22: 30 MHz ... 1 GHz, QP, single power supply EN 55022 / CISPR 22: 30 MHz ... 1 GHz, QP, 2 power supplies in a system	Class A 6 dB margin Class A
Harmonic Emissions	IEC 61000-3-2, $V_i = 115 \text{ VAC} / 60 \text{ Hz} \& 230 \text{ VAC} / 50 \text{ Hz}$ , 100% Load	Class A
AC Flicker	IEC 61000-3-3, $V_i = 230 \text{ VAC} / 50 \text{ Hz}$ , 100% Load	Pass
Acoustical Noise	Distance 1 meter, 25°C, 50% Load	65 dBA

## 12. SAFETY / APPROVALS

Maximum electric strength testing is performed in the factory according to IEC/EN 60950, and UL 60950. Input-to-output electric strength tests should not be repeated in the field. Bel Power Solutions will not honor any warranty claims resulting from electric strength field tests.

PARAMETER	DESCRIPTION / CONDITION	NOTES
Agency Approvals	Approved to latest edition of the following standards: UL/CSA60950-1, IEC60950-1 and EN60950-1, NEMKO NO86275, EAC NO 0230738, BSMI CNS14336-1 and CNS13438	
Isolation Strength	Input (L/N) to chassis (PE)	Basic
	Input (L/N) to output	Reinforced
	Output to chassis	None (Direct connection)
Creepage / Clearance	Primary (L/N) to chassis (PE)	
	Primary to secondary	
Electrical Strength Test	Input to chassis	Min. 2121 VDC
	Input to output (tested by manufacturer only)	4242 VDC

## 13. ENVIRONMENTAL

PARAMETER	DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
$T_A$ Ambient Temperature	Up to 1'000m ASL Linear derating from 1'000 to 3'048m ASL	0		+55 +45	°C °C/
$T_{Aext}$ Extended Temp. Range				TBD	°C
$T_S$ Storage Temperature	Non-operational	-20		+70	°C
Altitude	Operational, above Sea Level	-		3'048	m
	Non-operational, above Sea Level	-		10'600	m
Shock, operational	Half sine, 11ms, 10 shocks per direction, 6 directions			1	g peak
Shock, non-operational				30	g peak
Vibration, sinusoidal, operational	IEC/EN 60068-2-6, sweep 5 to 500 to 5 Hz, 1 octave/min, 5 sweep per axis			1	g peak
Vibration, sinusoidal, non-operational				4	g peak
Vibration, random, non-operational	IEC/EN 60068-2-64, 5 to 500 Hz, 1 hour per axis			0.025	g <sup>2</sup> /Hz

## 14. RELIABILITY

PARAMETER	DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
<i>MTBF</i> Mean time to failure	$T_A = 25^{\circ}\text{C}$ , according Telcordia SR-332, issue 3, GB, confidence level = 90%	860			kh

## 15. MECHANICAL

PARAMETER	DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
Dimensions	Width		73.5		mm
	Height		40.0		mm
	Depth		265.0		mm
<i>m</i> Weight			1.1		kg

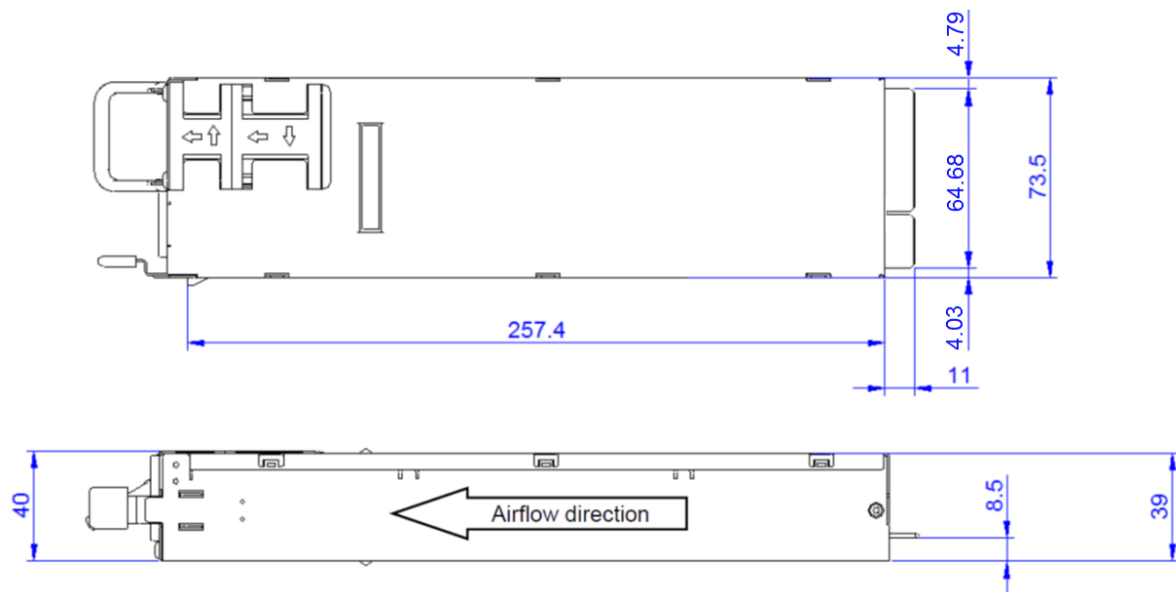


Figure 35. Top and side view

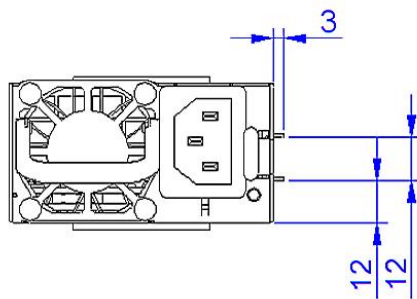


Figure 36. Front view

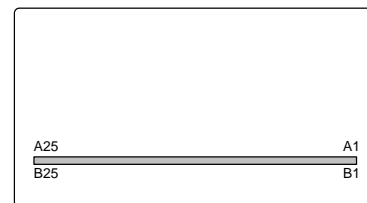


Figure 37. Rear view

## 16. CONNECTORS

PARAMETER	DESCRIPTION / CONDITION	MIN	NOM	MAX	UNIT
AC inlet	IEC 60320 C14				
AC cord requirement	Wire size		16		AWG
Output connector	25-Pin PCB card edge				
Mating output connector	FCI 10035388-106 or equivalent				



PIN	SIGNAL NAME	DESCRIPTION
A1 ~ A9	GND	Power and signal ground (return)
B1 ~ B9	GND	
A10 ~ A18	V1	+12 VDC main output
B10 ~ B18	V1	
A19	SDA	I <sup>2</sup> C data signal line
A20	SCL	I <sup>2</sup> C clock signal line
A21	PSON_L	Power supply on input, active-low
A22	SMB_ALERT_L	SMB Alert signal output, active-low
A23	V1_SENSE_R	Main output negative sense
A24	V1_SENSE	Main output positive sense
A25	PWOK_H	Power OK signal output, active-high
B19	A0	I <sup>2</sup> C address selection input
B20	A1	
B21	VSB	+12 V Standby positive output
B22	HOTSTANDBYEN_L	Hot standby enable signal, active-high
B23	ISHARE	Analog current share bus
B24	PRESENT_L <sup>7)</sup>	Power supply seated, active-low
B25	A2 <sup>7)</sup>	I <sup>2</sup> C address selection input

Table 5. Output connector pin assignment

<sup>7)</sup> Available only on model PET1600-12-074NAS311, open circuit on standard model PET1600-12-074NA



## 17. ACCESSORIES

ITEM	DESCRIPTION	ORDERING PART NUMBER	SOURCE
	<b>I<sup>2</sup>C Utility</b> Windows XP/Vista/7 compatible GUI to program, control and monitor PET1600-12-074NA Front-Ends (and other I <sup>2</sup> C units)	ZS-00130	<a href="http://belfuse.com/power-solutions">belfuse.com/power-solutions</a>
	<b>Evaluation Board</b> Connector board to operate PET1600-12-074NA. Includes an on-board USB to I <sup>2</sup> C converter (use I <sup>2</sup> C Utility as desktop software).	YTM.00045	<a href="http://belfuse.com/power-solutions">belfuse.com/power-solutions</a>

**For more information on these products consult: [tech.support@psbel.com](mailto:tech.support@psbel.com)**

**NUCLEAR AND MEDICAL APPLICATIONS** - Products are not designed or intended for use as critical components in life support systems, equipment used in hazardous environments, or nuclear control systems.

**TECHNICAL REVISIONS** - The appearance of products, including safety agency certifications pictured on labels, may change depending on the date manufactured. Specifications are subject to change without notice.

Компания «Life Electronics» занимается поставками электронных компонентов импортного и отечественного производства от производителей и со складов крупных дистрибьюторов Европы, Америки и Азии.

С конца 2013 года компания активно расширяет линейку поставок компонентов по направлению коаксиальный кабель, кварцевые генераторы и конденсаторы (керамические, пленочные, электролитические), за счёт заключения дистрибьюторских договоров

Мы предлагаем:

- Конкурентоспособные цены и скидки постоянным клиентам.
- Специальные условия для постоянных клиентов.
- Подбор аналогов.
- Поставку компонентов в любых объемах, удовлетворяющих вашим потребностям.
- Приемлемые сроки поставки, возможна ускоренная поставка.
- Доставку товара в любую точку России и стран СНГ.
- Комплексную поставку.
- Работу по проектам и поставку образцов.
- Формирование склада под заказчика.
- Сертификаты соответствия на поставляемую продукцию (по желанию клиента).
- Тестирование поставляемой продукции.
- Поставку компонентов, требующих военную и космическую приемку.
- Входной контроль качества.
- Наличие сертификата ISO.

В составе нашей компании организован Конструкторский отдел, призванный помогать разработчикам, и инженерам.

Конструкторский отдел помогает осуществить:

- Регистрацию проекта у производителя компонентов.
- Техническую поддержку проекта.
- Защиту от снятия компонента с производства.
- Оценку стоимости проекта по компонентам.
- Изготовление тестовой платы монтаж и пусконаладочные работы.



Тел: +7 (812) 336 43 04 (многоканальный)

Email: [org@lifeelectronics.ru](mailto:org@lifeelectronics.ru)

[www.lifeelectronics.ru](http://www.lifeelectronics.ru)