

Snapak® SeriesMagnetic Circuit Protectors



Introduction • 55

Handles • 56

Configurations • 61


Operating Characteristics • 63

Delay Curves • 64

Specifications • 65

Hardware • 66

Decision Tables • 67

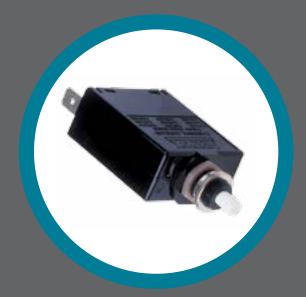





AIRPAX® | T/R/PP/PR/CR/CPP/CPR Series

Hydraulic Magnetic Circuit Protectors (SNAPAK®)

INTRODUCTION

The Airpax™ SNAPAK® series is a snap-acting hydraulic-magnetic circuit protector that combines power switching and accurate, reliable circuit protection in one aesthetically pleasing package. The SNAPAK® combines the functions of three separate components: power switch, fuse and fuse holder. To the OEM, this means that only one item has to be mounted instead of three. Less assembly is required, inventory is cut by two-thirds and greater panel density is obtainable with less clutter. In addition, the SNAPAK® can be operated at either DC or 50/60Hz, eliminating the need to specify, order and stock separate units. 400Hz units are also available.

To enhance front-panel aesthetics, SNAPAK® is offered with paddle and rocker handles in six attractive colors and push-pull and push-to-reset actuators. Also offered is a variety of optional mounting hardware. The push-pull version is supplied with a black button with a white indicating band.

Orientation of the button when marked with an amperage notation must be specified when using the fourth decision table. Push-to-reset is supplied with a contrasting color indicating shaft. In addition, SNAPAK® is offered in SPST and DPST configurations. The single pole satisfies most applications. The two-pole version is often used for extra safety in products that utilize high voltage or where current sensing and breaking of both sides of the line is required. Quick connect terminals are standard, UNC 8-32 or M4 screw terminals are available as additional termination options.


Since the SNAPAK® is snap-acting, it assures immediate opening and closing of the contacts. Its design also prevents operator "teasing" of the contacts and minimizes arcing. SNAPAK® circuit protectors are UL Recognized as supplementary protectors per UL STD. 1077, CSA Certified as supplementary protectors per CSA STD. C22.2 No. 235, TUV Approved as circuit breakers for equipment per STD. EN 60934, CCC Approved (customer must request product be manufactured in China) and CE Compliant. In addition, most versions are certified by UL to meet spacing requirements of IEC 950 for basic and functional insulation for front panel mounting.

Consult factory for details and exceptions. Typical applications include office appliances, electronic data processing, medical equipment, business machines, vending and amusement machines. Push-pull versions are particularly well suited for medical instrumentation, automotive production transfer lines and other applications where accidental turn off is unacceptable. For those applications which do not require circuit protection, SNAPAK® is offered in a power-switch-only configuration.


TOGGLE ACTUATORS

The SNAPAK® is available with paddle handles in six attractive colors. Engineered for safe, sure operation, the paddle handles may be specified in blue, white, red, green, yellow or black.

Mounting Details with Locking Ring





without Locking Ring



PANEL CUTOUT SHOWN ABOVE MAY BE MADE WITH GREENLEE RADIO CHASSIS PUNCH #733 x 1/2" DIA.

Note: Mounting Tolerance \pm .005 [.13] unless noted angles: $\pm 5^{\circ}$. Dimensions in Brackets [] are millimeters.

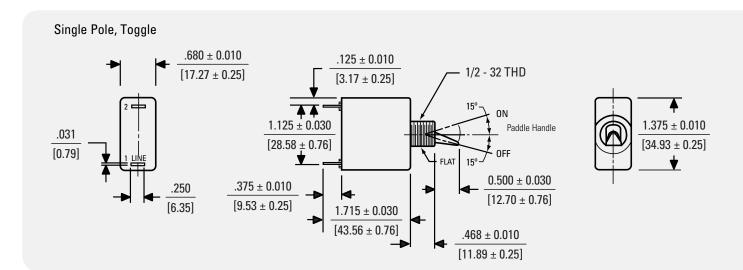

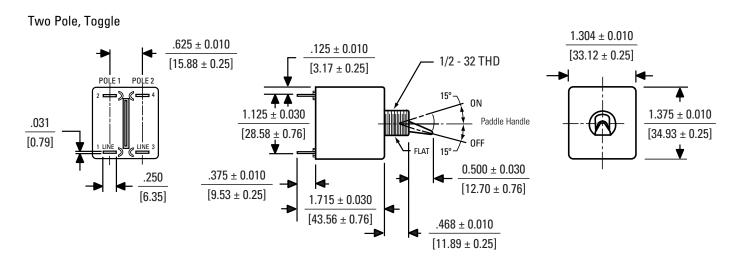




ROCKER HANDLES WITH ILLUMINATION


SNAPAKs are offered in single and two pole rocker styles in a choice of black, white or gray body colors. Handle color in non-illuminated types may be black, red, white or orange. Neon or light emitting diode (LED) illumination may be specified with a variety of options.


SNAPAK® circuit protectors with a second pole are available in paddle handle, push-pull, push-to-reset and rocker handle versions.

Mounting Detail



Rocker, Single Pole

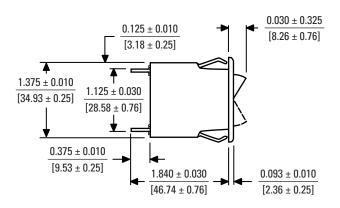


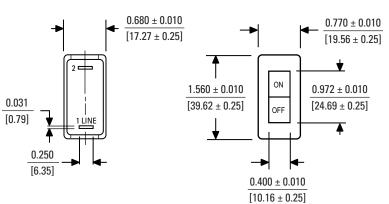


HANDLE GUARDS


The SNAPAK® circuit protector is available with an optional handle guard as an integrated part of the snap-in mounting design. Available for rocker actuators, the guard helps in providing protection from accidental "turn-off." Please refer to the SNAPAK® Part Number Decision Tables; fourth decision.


Handle Guards, Single Pole





Handle Guards, Two Pole







FRONT SNAP-IN MOUNT (STD)

Panel Thickness	0.125	0.093	0.062
	[3.18]	[2.36]	[1.57]
Dimension "A"	1.460	1.420	1.385
	[37.08]	[36.07]	[35.18]
Note: Tolerance for Mtg. ± .005 (.13)			


Mounting Detail $\frac{1.329 \pm .010}{[33.76 \pm .025]}$



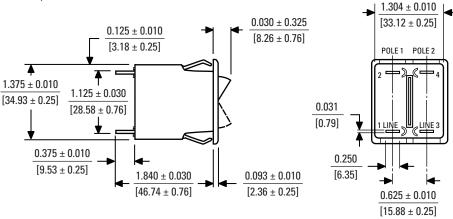




Illuminated Handle Single Pole



Two Pole




Note: Tolerance ± .005 [.13] unless noted angles: ±5°. Dimensions in Brackets [] are millimeters.





PUSH-PULL, PUSH-TO-RESET ACTUATOR

SNAPAK[®] may also be ordered with Push-Pull, or Push-to-Reset actuator buttons. As an option, the button can be embossed with the current rating (Push-Pull option only).


Push-Pull, Single Pole

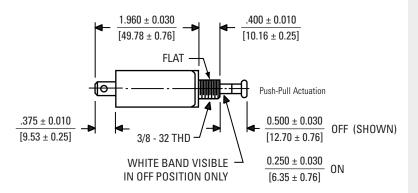







Mounting Detail (Single Pole and Two Pole)




Note: Tolerance ± .005 [.13] unless noted angles: ±5°. Dimensions in Brackets [] are millimeters.


Push-Pull, Two Pole

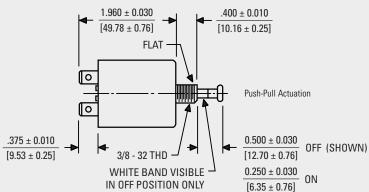






Push-to-Reset Actuation (Single and Two Pole)




SCREW TERMINALS


Available as straight screw terminals with UNC 8-32 and Metric M4 screw types, bus-type connect (flat) or upturned lugs (tabs), with UL, CSA and TÜV approvals available. Screw terminals are available for all handle options (rocker, toggle, push-pull, push-to-reset). Single pole only, series only, non-auxiliary switch configurations.

DIMENSION "	Α"	
Handle Style	Screw Terminal	"A" Dimension
Toggle	Straight	1.773 [45.03]
Push Button	Straight	2.180 [55.37]
Rocker	Straight	2.058 [52.27]










Straight





CONFIGURATIONS

Series Trip


The most popular configuration for magnetic protectors is the series trip where the sensing coil and the contacts are in series with the load being protected. In addition to providing conventional overcurrent protection, it is simultaneously used as an on-off switch.


Shunt Trip


The shunt trip is designed for controlling two separate loads with one assembly. The control is established by providing overload protection for the critical load. When the current through this load becomes excessive and reaches the trip point, the protector will open and remove power from both loads simultaneously. The current rating of both loads must not exceed the maximum contact rating.

Relay Trip

This permits the overload sensing coil to be placed in a circuit which is electrically isolated from the contacts. The coil may be actuated by sensors monitoring pressure, flow, temperature, speed, etc. Other typical applications include crowbar, interlock and emergency/rapid shutdown circuitry. Trip may be accomplished by voltage or current, which must be removed after trip.

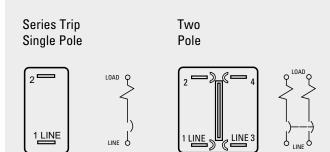

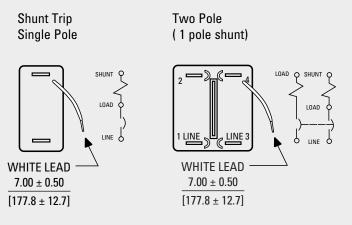

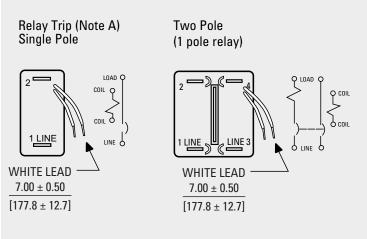

Note A: Coil Ratings to 5 amperes maximum. Contact ratings are 7.5 amperes at 50 Vdc and 250 Vac; 15 amperes at 120 Vac; 32 Vdc.

Note: Tolerance ± .005 [.13] unless noted.

Dimensions in Brackets [] are millimeters.

Auxiliary Switch

This is furnished as an integral part of a series pole in single or, multi-pole assemblies. Isolated electrically from the protectors circuit, the switch works in unison with the power contacts and provides indication at a remote location of the protector's ON-OFF status.


Voltage Trip


Sometimes called "dump circuits" or "panic trip circuits," these units make it possible to open main power contacts with lower power inputs from one or more sources. This configuration is becoming increasingly more important for sensitive circuitry and denser packaging in automation systems. Available in series, shunt or relay configurations.

Power Switch

In the event that over-current protection is not desired, the coil mechanism can be deleted, providing an excellent low cost single or double-pole power switch. Maximum current rating is 20 amps.


Auxiliary Switch (Note B) Single Pole



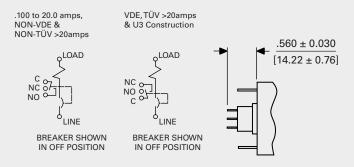

Auxiliary Switch (Note B) Two Pole



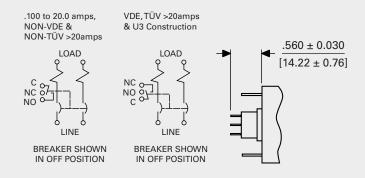

Note B: Switch is located in the left hand pole (viewed from terminal end).



OPERATING CHARACTERISTICS

Inrush Pulse Tolerance

Many circuit protector applications involve a transformer turn-on, an incandescent lamp load, or a capacitor charge from a DC source. Each of these applications has one common factor: a steep transient of very high current amplitude and short duration. This takes the form of a spike or a single pulse and is the cause of most nuisance tripping associated with magnetic circuit breakers.


SNAPAK® will withstand, without tripping, a single pulse of 8 milli-seconds duration (half sine wave configuration) and peak amplitude of 9 times its rating without the inertia wheel and 13 times its rating with an inertia wheel. (Not applicable to instant trip delays).


MAXIMUM DC	R AND IMPEDA	NCE	
Current Ratings (Amps)	T/R/PP/PR DC Resistance	T/R/PP/PR 50/60Hz Impedance	CR/CPP/CPR DC Resistance
.100	175	181	274
.500	6.34	6.63	9.77
1.00	1.63	1.69	2.31
2.00	.400	.425	.465
3.00	.175	.188	.261
4.00	.103	.106	.156
5.00	.076	.078	.091
7.50	.038	.039	.053
10.0	.026	.028	.023
12.5	.020	.021	.020
15.0	.013	.014	.010
20.0	.010	.011	.008
25.0			.004
30.0			.003


DCR and Impedance is measured after 1 hour at 100% rated current using the Voltmeter-Ammeter Method.

PULSE TOLERANCE	
Delay	Pulse Tolerance
1, 2, 61, 62	*9 Times Rated Current
3, 4, 61F, 62F	*13 Times Rated Current
* Units al	pove 15 amps are derated to 8 and 12 times rated current

PERCENTAG	E OF RATED CUF	RRENT VS TRIP	TIME IN SECO	NDS AT +25°C (\	/ERTICAL MOUI	NT)	
Delay	100%	135%	150% *	200%	400%	600%	800%
Instant	No Trip	May Trip	.100 Max	.100 Max	.100 Max	.100 Max	.100 Max
Fast	No Trip	.3 to 7	.2 to 5	.1 to 2	.03 to .50	.015 to .30	.010 to .150
Slow	No Trip	3 to 70	2 to 40	1 to 15	.10 to 4.0	.015 to 2.0	.010 to .800
					* Minimum t	rip for all instantaned	us and 400Hz units.

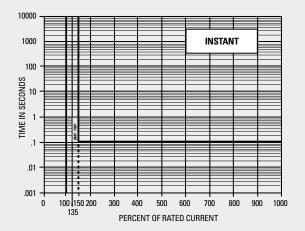

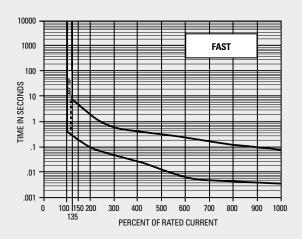

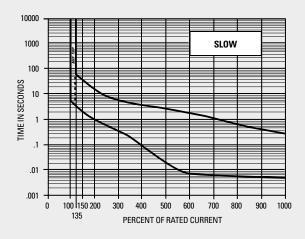

DELAY CURVES & SPECIFICATIONS

400 Hz, DC, 50/60Hz Delay Curves (typ)

A choice of delays is offered for DC, 50/60Hz and 400Hz applications. Delays 0, 49, 59 and 69 provide fast-acting, instantaneous trip and are often used to protect sensitive electronic equipment (not recommended where known inrush exists). Delays 1, 41, 51 and 61 have a short delay for general purpose applications. Delays 2, 42, 52 and 62 are long enough to start certain types of motors and most transformer and capacitor loads.

Trip Free

Will trip open on overload, even when forcibly held on. This prevents operator from damaging the circuit by holding handle in the ON position.

Trip Indication

The operating handle moves forcibly and positively to the OFF position on overload.

Ambient Operation

Operates normally in temperatures between -40° C and +85°C.

Insulation Resistance

Not less than 100 megohms at 500Vdc.

Dielectric Strength

Withstands 1500 volts, 60Hz for 60 seconds or 1800Vac for one second between all electrically isolated terminals.

Endurance

Mechanical life in excess of 50,000 operations. In many applications, however, contact wear due to the electrical load determines unit life. At maximum electrical ratings, the SNAPAK® can perform 10,000 operations at rated current and voltage. Under UL 1077, the SNAPAK® can perform 50 operations at 150% of maximum rated current followed by 6,000 operations at maximum rated current. Under EN60934 the SNAPAK® can perform 6,000 electrical operations. After any endurance cycle, the breaker will calibrate and have working dielectric strength.



AGENCY APPROVALS (T/P/PP/PR SUPPLEMENTARY PROTECTORS) Voltage (Volts), Frequency (hz), Phase, Min Poles, TC, OL **Current (Amps) Short Circuit Current Rating (Amps)** Voltage Frequency (Hz) Phase Min. Poles TC OL UL/CSA TUV UL 1077 & CSA TUV Notes 32 DC 0 10-30(3) .10-20 U1, 1000 500 38 DC 0 10-15 U2, 1000 / U1, 1000 PR only DC U2, 500 /U1, 500 65 1 0 10-7.5 DC 10-15 U1, 1000 65 2 0 65 DC 2 0 10-20 .10-20 U2.500 / U1.500 500 65(2) DC 0 10-30 .10-30 U2, 120 120 R, PP, PR only 65(2) DC 2 only 0 10-25 U1, 100 R only DC 2 0 10-25 U2, 500 65(2) R only 0 10-20 7.6-20 U1. 1000 500 125 50/60 125 50/60 1 0 10-30(3 U1. 1000 T only 1 n 125(2) 50/60 10-30 112 1000 R PP PR only 125(2) 50/60 10-30 20.1-30 U3, 300(1) รกก R. PP. PR only 120/240 50/60 2 0 10-20(3 U2, 1000 120/240 50/60 2 0 10-30(3) U1. 650 125/250 50/60 2 0 10-20 U1, 1000 50/60 0 .1-7.5 U1, 500 500 250 10-20 250 50/60 0 10-7.5 C1, 1000(4) 250 50/60 0 10-20 10-20 U1, 1000 500 250(2) 50/60 10-30 U3, 300 R only 125 400 10-20 U1. 1000 0 125/250 400 10-20 U1, 1000 0 400 U1, 1000 250 2 0 10-20 400 U1, 1000 250 2 0 .10-7.5 CR/CPP/CPR COMMUNICATIONS EQUIPMENT CIRCUIT BREAKERS 65 DC 1 only 10-30 10-30 1000 1000 DC. 600 เลก 1 only 10-30 10-30 600 (1) Non-standard construction. "Fit For Further Use" approval; (2) Non-snap action design; (3) No auxiliary switch available above 20A; (4) With 30A max. series fuse

All supplementary protectors are of the overcurrent (OC) type

The family of protectors has been evaluated for end use application for use group (UG) A

The terminals (FW) are suitable for factory wiring only (0)

The maximum voltage ratings for which the protectors have been tested are shown in the chart

The current is the amperage range that the protectors have been tested

The tripping current (TC) for the protectors is either "1" (in the range of 125% to 135% of ampere rating) or "2" (more than 135% of ampere rating)

The overload rating (OL) - designates whether the protector has been tested for general use or motor starting applications.

 $0-tested \ at \ 1.5 \ times \ amp \ rating \ for \ general \ use$

1 - tested at 6 times AC rating or 10 times DC rating for motor starting

The short circuit current rating (SC) – The short circuit rating in amperes following a letter and number designating the test conditions and any calibration following the short circuit test is defined below

AUXILIARY SWITCH RATING					
Silver					
3.0 amps	@	120 VAC			
1.5 amps	@		32 VDC		
Gold					
.100 amps	@	32 VAC	32VDC		

APPROXIMATE WEIGHT PER POLE		
	Ounces	Grams
Rocker Configuration	0.9	25
Toggle, PP, PR	1.2	32

- C Indicates short circuit test was conducted with series overcurrent protection
- U Indicates short circuit test was conducted without series overcurrent protection
- 1 Indicates a recalibration was not conducted as part of the short circuit testing
- 2 Indicates a recalibration was performed as part of the short circuit testing
- 3 Indicates recalibration was performed along with the dielectric and voltage withstand for "Suitable for Further

Short Circuit Interrupting Capacity

1000 amperes maximum for UL and CSA, 500 amperes maximum for TUV. Consult factory for details. Handle and Body Material

The handle and upper body material is polycarbonate and the lower body is PET.

Chemical Resistance

Handle and case may be cleaned with detergents or alcohols and should be restricted to outside surfaces only. Organic solvents are not recommended. Special attention should be given when solvents are used to remove excess flux from terminals. No oils or lubricants should be introduced into handle openings or onto bushing

IEC, UL, CSA, SEV, VDE, CCC, CE, TÜV

Recognized by UL to STD-1077 and UL certified to spacing requirements of IEC 950 for basic and functional insulation for front panel mounting. Certified by CSA, file number LR26229 as recognized supplementary protectors, SEV approved, CCC approved, TDV approved (including screw terminals) to ENB0934. TUV approval of unmarket rocker handle option for appliance disconnect requires status of protectors to be indicated on the panel. Only TUV approved part numbers will be marked CE compliant. See shaded areas of part number decision tables for approved configurations and/or consult factory for exceptions and limitations.

Withstands 75G without tripping while carrying full rated current per MIL-STD-202, Method 213, Test Condition I. Instant trip breakers are tested at 80% of rated current

Time delayed units withstand 10G without tripping while carrying full rated current per MIL-STD-202, Method 204, Test Condition A. Instant trip breakers are tested at 80% of rated current III 489A Listed

The CR, CPP and CPR are dimensionally the same as the popular R, PP and PR Snapack products, but provide UL listing to UL489A for Communications Equipment. Available only in single pole with DC trip time delays for series or series with silver auxiliary switch configurations. As a circuit breaker, the CR, CPP or CPR provides communication equipment manufacturers with a UL listed circuit breaker in an extremely compact package that meets the stringent environmental requirements of today's marketplace. This makes the CR, CPP and CPR ideal for switching, transmission and wireless applications.


Paddle Handle Hardware




JIFF O

Vertical Mount


– B Horizontal Mount






Knurled Nut

Panel Dress Nut






Hex Nut

Locking Ring (Toggle)

Push-Pull & Push-to-Reset Hardware



3/8 - 32 Panel Nut Bright Nickel



Note: Tolerance \pm .010 [.25] unless noted. Dimensions in brackets [] are millimeters.

Bright Nickel

HARDWARE

Indicator Plates

SNAPAK® toggle handle circuit protectors may be specified with indicator plates for either vertical or horizontal mounting. The "ON-OFF/O-I" plate is standard.

Note 1:

To allow for installation clearances, the minimum recommended distances between centers of panel openings should be:

RECOMMENDED CENT	ER DISTANCES FOR PANEL OPENINGS
Breaker Type	Distance, inches [mm]
T11	0.750 [19.05]
T21	1.375 [34.93]
PP11 & PR11	0.750 [19.05]
PP21 & PR21	1.375 [34.93]
R11	0.805 [20.45]
R21	1.429 [36.30]

Note 2: Torque on mounting hardware is not to exceed 25 inch-pounds for 1/2 inch bushings or 15 inch-pounds for 3/8 inch bushings.

Mounting Nuts (Toggle)

A choice of knurled, dress and hex nuts are available. All three are available in bright nickel. The knurled and dress nuts are also available in a matte black finish. Every SNAPAK® comes with a hex nut, but you may order the front panel nuts which will best enhance your design.

Miscellaneous Hardware

SNAPAK® circuit protectors with 1/2-32 thread may also be equipped with optional locking rings to prevent rotation of the unit after it is installed.

3/8 - 32 Hex Nut and Panel Nuts

The hardware will be supplied with each Push-Pull (PP) and Push-to-Reset (PR).

3/8 - 32 Panel Nut

This nut when reversed will provide alignment in .437 (11.1) and .468 (11.88) diameter round panel holes.



HOW TO ORDER

The ordering code for the SNAPAK® circuit protectors may be determined by following the steps in the decision tables shown here.

from terminal end. Shunt or relay construction available in pole 2 only, other pole must be a series

**UL 489A listed, available in 1 pole series or series w/silver aux. switch. DC delay only


or switch only construction

The coding given permits a self-assigning part number, with certain limitations (due to the adaptability of magnetic protectors to complex circuits), requires a factory-assigned part number.

The example shown is the code for a paddle handle, single pole (UL construction), series circuit protector designed for operation of a 50/60Hz/DC circuit. A slow time delay and rating of 5 amperes has been indicated. Handle color is black, and a bright nickel knurled nut, vertical mount (ON-OFF) indicator plate and locking ring are to be supplied.

To determine the ordering code for your particular SNAPAK® unit, simply follow the steps shown, then fill in the letters and/ or numbers in the boxes. Space is available on the circuit breaker label for your part number (up to 12) digits). You may then use your own part number to place an order or as a reference for further questions you may have. This option does require a factory assigned part number for traceability to your drawing or internal part number.

	Handle		Poles		Configurations*		Terminals	
Т	Paddle Handle	1	Single Pole †	0	Switch Only (Note E)		Quick Connects (leave blank)	
PP	Push-Pull	4	Single Pole ††	1	Series Circuit Protector	s	Screw Terminals,	
PR	Push-To-Reset	2	Two Pole †	3	Shunt Circuit Protector		Single pole (-1) and series only	
R	Rocker	5	Two Pole ††	4	Relay Circuit Protector ††††	1	(5th decision, group V - screw terminal option is required when 1st decision "S" is	
CR	Rocker	**		5	Series w/ Silver Aux. Switch †††			
СРР	Push-Pull	**		6	Series w/ Gold Aux. Switch †††		specified)	
CPR	Push to Reset	**		9	Mixed Construction (2 Pole Only)			
† †† ††† †††	•	struct ocate cings	d in the left hand pole for many IEC / TUV equ					

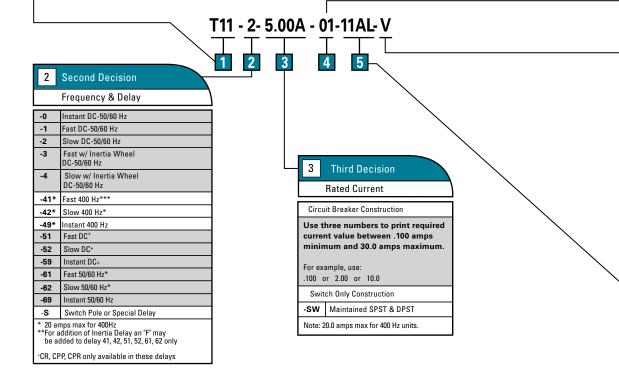

Notes:

- A A neon bulb is provided when specified for 120Vac and 250Vac operation. For operation at 120Vac a 33,000 ohm, 1/2 watt external resistor is required. At 250Vac a 100,000 ohm, 1 watt external resistor is required.
- B An LED with 750 ft. L @ 20mA is provided in the center of the handle. Maximum power dissipation @ 25°C is 135mW. Continuous forward current is 20mA. Forward voltage, typical, is 1.6v at 20mA. Reverse current, typical, is 100mA @ 3.0 volts. An external resistor may be required to limit current to these values.
- C When ordering Paddle Handles, you may choose one item from each hardware group to add to 5th decision if such items are desired. For example, "-11ALCA" would indicate a bright nickel knurled nut, plus a vertical mount indicator, plus a locking ring, plus #8-32 screw terminal, straight with tabs.
- D All units except Rocker units will have (1) hex nut installed as standard hardware for the back of a panel. The choices in the fifth decision table are intended for the front or visible side of the panel and are offered for Paddle Handle configuration only. Push-Pull and Push-to-Reset configurations include one (1) panel nut and one (1) hex nut as standard hardware.
- E Switch only no current overload protection provided.
- F. CCC Approval If CCC is required on this product, please inform Sensata to have this product manufacturered in our China facility

4 Fourth Decision

	Rocker		
	Step 1: Choose Letter For Body Colo	r	
В	Black	R	Black w/ Handle guard
G	Gray	S	Gray w/ Handle guard
W	White	Т	White w/ Handle guard
	Example: For White Rocke	r Body	"W…" · (Rocker Style)

	Step: 2: Choose Handle Combinations					
	Without Illumination Basic Handle C	olor (w/o Markings)				
01	Black					
02	Red	Example: "-W06"				
06						
07	Orange					
	With Illumination Basic Handle Colo	r & Light Choice (w/o Markings)				
101	Clear w/Neon (Note A)					
102	Clear w/Green Glow Neon (Note A)					
103	Clear w/Red LED (Note B)					
104	Clear w/4-8 Vdc Red LED					
105	Clear w/8-16 Vdc Red LED					
107	Clear w/Green LED (Note B)					
108	Clear w/4-8 Vdc Green LED					
109	Clear w/8-16 Vdc Green LED					
121	Transparent Red w/Neon (Note A)					

101	Clear W/Neon (Note A)
102	Clear w/Green Glow Neon (Note A)
103	Clear w/Red LED (Note B)
104	Clear w/4-8 Vdc Red LED
105	Clear w/8-16 Vdc Red LED
107	Clear w/Green LED (Note B)
108	Clear w/4-8 Vdc Green LED
109	Clear w/8-16 Vdc Green LED
121	Transparent Red w/Neon (Note A)
123	Transparent Red w/Red LED (Note B)
124	Transparent Red w/Red LED 4-8 Vdc
125	Transparent Red w/Red LED 8-16 Vdc
161	Translucent White w/Neon (Note A)
162	Translucent White w/ Green Glow Neon (Note A)
171	Transparent Amber w/Neon (Note A)
181	Transparent Smoke Gray w/Neon (Note A)
182	Transparent Smoke Gray w/Green Glow Neon (Note A)
183	Transparent Smoke Gray w/Red LED (Note B)
184	Transparent Smoke Gray w/4-8 Vdc Red LED
185	Transparent Smoke Gray w/8-16 Vdc Red LED
187	Transparent Smoke Gray w/Green LED (Note B)
188	Transparent Smoke Gray w/4-8 Vdc Green LED
189	Transparent Smoke Gray w/8-16 Vdc Green LED
	Example: "-W124"
	If you prefer NO markings, then your handle decision is now complete.

Step 3: Choose Handle Markings							
Marked For Vertical Mount-After choice of 3 digit number in step 2 above.							
Add "CV" for Combined markings.	Add " EV " for English markings. Example: "-W124EV"	Add "IV" for Intil. markings.					
Marked For Horizontal Mou	Marked For Horizontal Mount-After choice of 3 digit number in step 2 above.						
Add "CH" for Combined markings.	Add "EH" for English markings. Example "-W06EH"	Add " IH " for International markings.					
If you have chosen a handle from this table, your 4th Decision and your catalog part number are now complete (except if you require "-S" screw terminal option from the 5th Decision Table.)							

	Paddle ^(T) Handle Color			
-01	Black			
-02	Red			
-03	Yellow			
-04	Green			
-05	Blue			
-06	White			
If you have chosen a handle from this table, your 4th Decision is now complete except for hardware options in 5th Decision Table.				

	Push-Pull (PP, CPP and CPR)							
-XX	No Button Markings desired (not available for CPP & CPR)							
-OA	LINE 5	Marked Buttons Available For These Amperages						
-ОВ	LINE (5)	0.1	1	10				
-ОВ		.25	2.5	15				
-oc	LINE	0.5	5	17.5				
		.75	7.5	20				
	If you have chosen a handle from this table, your 4th Decision & your catalog PN are now complete (except if you require "-S" screw terminal option from the 5th Decision Table.)							

	Push-to-Reset (PR)				
-XX	No Button Markings Only				
If you have already from this table your Ath Desiries and your					

If you have chosen a handle from this table, your 4th Decision and your catalog PN are now complete (except if you require "-S" screw terminal option from the 5th Decision Table.)

5 Fifth Decision

Hardware & Accessories (Notes C and D)

	Group I	Group II (Indicator Plate)		Group V (Screw Terminal Options)				
-00	No Outer Hardware Desired		N 114		045000 11 (7.1.)	_		
-10	Black Knurled Nut	-A	Vertical Mount (Off/On & O/I)*	-C	SAE 8-32, Upturned Lugs (Tabs) Straight Terminal	-F	M4, Upturned Lugs (Tabs) Straight Terminal	
-11	Bright Nickel Knurled Nut							
-20	Black Panel Dress Nut		Horizontal Mount (Off/On & O/I)*	-D	SAE 8-32, Bus-Type Connect (Flat) Straight Terminal	-H	M4, Bus-Type Connect (Flat) Straight Terminal	
-21	Bright Nickel Panel Dress Nut	-В						
-31	Bright Nickel Hex Nut							
	Group III							
-L	Locking Ring		lection of A or B Indicator Plate quired for TUV and CCC.	Please select a screw terminal option if you selected "S" in Decision 1				

$\mathbf{T}, \mathbf{V} = \mathbf{T}\ddot{\mathbf{U}}\mathbf{V}$ and CCC Approved

The shaded areas denote CCC (if applicable) and CE compliant options.

The V will be added to any part number formed entirely from shaded decisions.

If non-shaded areas are selected, the unit will not be approved, nor CE compliant, but other approvals still apply. 20 amps max rating on units.



OOO «ЛайфЭлектроникс" "LifeElectronics" LLC

ИНН 7805602321 КПП 780501001 P/C 40702810122510004610 ФАКБ "АБСОЛЮТ БАНК" (ЗАО) в г.Санкт-Петербурге К/С 3010181090000000703 БИК 044030703

Компания «Life Electronics» занимается поставками электронных компонентов импортного и отечественного производства от производителей и со складов крупных дистрибьюторов Европы, Америки и Азии.

С конца 2013 года компания активно расширяет линейку поставок компонентов по направлению коаксиальный кабель, кварцевые генераторы и конденсаторы (керамические, пленочные, электролитические), за счёт заключения дистрибьюторских договоров

Мы предлагаем:

- Конкурентоспособные цены и скидки постоянным клиентам.
- Специальные условия для постоянных клиентов.
- Подбор аналогов.
- Поставку компонентов в любых объемах, удовлетворяющих вашим потребностям.
- Приемлемые сроки поставки, возможна ускоренная поставка.
- Доставку товара в любую точку России и стран СНГ.
- Комплексную поставку.
- Работу по проектам и поставку образцов.
- Формирование склада под заказчика.
- Сертификаты соответствия на поставляемую продукцию (по желанию клиента).
- Тестирование поставляемой продукции.
- Поставку компонентов, требующих военную и космическую приемку.
- Входной контроль качества.
- Наличие сертификата ISO.

В составе нашей компании организован Конструкторский отдел, призванный помогать разработчикам, и инженерам.

Конструкторский отдел помогает осуществить:

- Регистрацию проекта у производителя компонентов.
- Техническую поддержку проекта.
- Защиту от снятия компонента с производства.
- Оценку стоимости проекта по компонентам.
- Изготовление тестовой платы монтаж и пусконаладочные работы.



Тел: +7 (812) 336 43 04 (многоканальный) Email: org@lifeelectronics.ru