


# ETD-BL-1T-OFF-CC-...

Timer relay with off delay (with control contact) and adjustable time

## INTERFACE

Data sheet  
103617\_en\_02

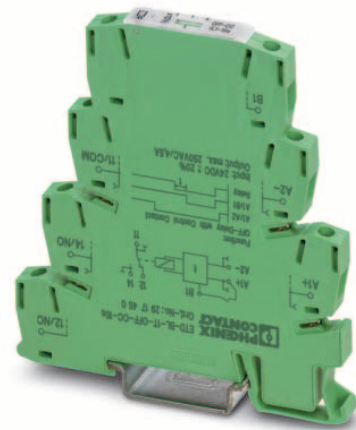

© PHOENIX CONTACT 2010-06-07

### 1 Description

Compact time relay in the 6.2 mm housing in order to control time sequences.

The time is set on the front side using a labeled knurled wheel which is sunk in order to prevent unintentional adjustment. The time can be set using a screwdriver (blade width 2.5 mm).

The compact time relays are available with varied time ranges as well as with screw and spring-cage connections.

### Features

- 6.2 mm narrow housing
- With off delay (with control contact)
- Adjustable time
- Easy and accurate time setting
- Supply voltage 24 V DC
- Output: A floating PDT



#### **WARNING: Risk of electric shock**

Never carry out work when voltage is present.



Make sure you always use the latest documentation. It can be downloaded at [www.phoenixcontact.net/catalog](http://www.phoenixcontact.net/catalog).



This data sheet is valid for all products listed on the following page:

## 2 Ordering data

| Description                                    | Type                       | Order No. | Pcs. / Pkt. |
|--|----------------------------|-----------|-------------|
| <b>Timer relay with screw connection</b>       |                            |           |             |
| Time range 0.1...10 s                          | ETD-BL-1T-OFF-CC- 10S      | 2917450   | 1           |
| Time range 3...300 s                           | ETD-BL-1T-OFF-CC-300S      | 2917463   | 1           |
| Time range 0.3...30 min                        | ETD-BL-1T-OFF-CC- 30MIN    | 2917467   | 1           |
| Time range 3...300 min                         | ETD-BL-1T-OFF-CC-300MIN    | 2917489   | 1           |
| <b>Timer relay with spring-cage connection</b> |                            |           |             |
| Time range 0.1...10 s                          | ETD-BL-1T-OFF-CC- 10S-SP   | 2917612   | 1           |
| Time range 3...300 s                           | ETD-BL-1T-OFF-CC-300S-SP   | 2917625   | 1           |
| Time range 0.3...30 min                        | ETD-BL-1T-OFF-CC- 30MIN-SP | 2917638   | 1           |
| Time range 3...300 min                         | ETD-BL-1T-OFF-CC-300MIN-SP | 2917641   | 1           |

## 3 Technical data

| Input data                 |   |
|----------------------------|---|
| Input voltage range        | 24 V DC (19,2 V DC ...30 V DC)                        |
| Time setting range         | 0.1 s ... 10 s  |
| ETD-BL-1T-OFF-CC- 10S      | 3 s ... 300 s   |
| ETD-BL-1T-OFF-CC-300S      | 0.3 min ... 30 min                                    |
| ETD-BL-1T-OFF-CC- 30MIN    | 3 min ... 300 min                                     |
| ETD-BL-1T-OFF-CC-300MIN    |   |
| ETD-BL-1T-OFF-CC- 10S-SP   | 0.1 s ... 10 s  |
| ETD-BL-1T-OFF-CC-300S-SP   | 3 s ... 300 s   |
| ETD-BL-1T-OFF-CC- 30MIN-SP | 0.3 min ... 30 min                                    |
| ETD-BL-1T-OFF-CC-300MIN-SP | 3 min ... 300 min                                     |
| Function                   | OFF-CC: Off delay with control contact                |
| Setting accuracy           | ≤ 2.5 % (of scale end value)                          |
| Repeat accuracy            | ≤ 0.5 % (From the measuring range final value)        |
| Nominal current typ.       | 15 mA (Relay ON)<br>7 mA (Relay OFF)                  |
| Output data                |   |
| Contact type               | 1 floating PDT  |
| Output fuse                | 6.3 A (fast-blow)                                     |
| Switching capacity         | 1500 VA (6 A / 250 V AC)                              |
| Control contact            |   |
| Control contact            | Non-floating, terminals A1-B1                         |
| Control pulse length       | min. 50 ms  |
| General data               |   |
| Service life mechanical    | Approx. $2 \times 10^7$ cycles                        |
| Service life, electrical   | Approx. $2 \times 10^5$ cycles at ohmic load, 1000 VA |
| Operating mode             | 100% operating factor                                 |
| Degree of protection       | IP20  |
| Pollution degree           | 2 (according to EN 50178)                             |
| Surge voltage category     | III, safe isolation (according to EN 50178)           |
| Rated insulation voltage   | 300 V AC (according to EN 50178)                      |

**General data (Continued)**

|                                    |  |
|------------------------------------|--|
| Impulse withstand voltage          | 6 kV (According to EN 50178)           |
| Inflammability class acc. to UL 94 | V0                                     |
| Assembly                           | on TS 35 profile rail acc. to EN 60715 |
| Mounting position                  | Any                                    |
| Width                              | 6.2 mm                                 |
| Height                             | 86 mm                                  |
| Length                             | 80 mm                                  |
| Type of housing                    | Polyamide PA, self-extinguishing       |
| Color                              | green                                  |

**Connection data Screw connection**

|                                   |  |
|-----------------------------------|--|
| Conductor cross section, solid    | 0.14 mm <sup>2</sup> ... 2.5 mm <sup>2</sup> |
| Conductor cross section, stranded | 0.14 mm <sup>2</sup> ... 2.5 mm <sup>2</sup> |
| Stripping length                  | 8 mm   |

**Connection data Spring-cage conn.**

|                                   |  |
|-----------------------------------|--|
| Conductor cross section, solid    | 0.14 mm <sup>2</sup> ... 2.5 mm <sup>2</sup> |
| Conductor cross section, stranded | 0.14 mm <sup>2</sup> ... 2.5 mm <sup>2</sup> |
| Stripping length                  | 8 mm   |

**Ambient conditions**

|   |                  |
|---|------------------|
| Ambient temperature (operation)         | -20 °C ... 65 °C |
| Ambient temperature (storage/transport) | -25 °C ... 80 °C |
| Permissible humidity (operation)        | 15 % ... 85 %    |

**Conformance / approvals**


|                  |                         |
|------------------|-------------------------|
| Conformity       | CE compliant            |
| ATEX             | Ⓔ II 3 G Ex nAC II T4 X |
| UL, USA / Canada | UL/C-UL listed UL 508   |
| GL               | GL EMC 1 C              |

**Conformance with EMC directive 2004/108/EC**

|                                       |              |
|---------------------------------------|--------------|
| Immunity to interference according to | EN 61000-6-2 |
| Emitted interference according to     | EN 61000-6-4 |

**Conformance with LV directive 2006/95/EC**

|  |          |
|--|----------|
| Electronic equipm. for electrical power installations according to | EN 50178 |
|--|----------|

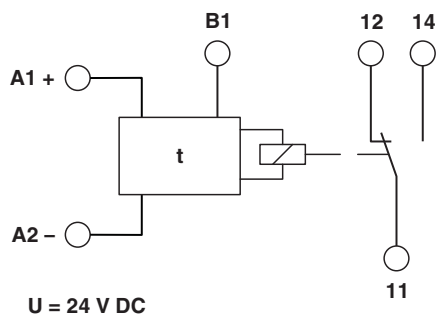**4 Block diagram**

## 5 Safety regulations and installation notes



**WARNING: Risk of electric shock**

Never carry out work when voltage is present.

### Installation notes



The device is designed for installation in potentially explosive areas in zone 2.



**Note:** Installation, operation and maintenance may be carried out only by qualified electricians. Follow the specified installation instructions. When installing and operating the device, the applicable safety directives (including national safety directives), accident prevention regulations, as well as general technical regulations, must be observed. The technical data should be taken from this data sheet and the certificates (conformity assessment, other possible approvals).



**Note:** Do not open the device or make changes to it. Do not repair the device yourself, replace it with an equivalent device. Repairs may only be carried out by the manufacturer. The manufacturer is not liable for any damage due to violation of the described regulations.



**Note:** The IP20 degree of protection (EN 60529) of the device is intended for a clean and dry environment. Do not subject the device to any load that exceeds the described limits.



**WARNING: Explosion hazard**

The device has not been designed for use in potentially dust-explosive atmospheres.

### Installation in Ex area (zone 2)



**Note:** Please observe the requirements defined for use in potentially explosive atmospheres!



**WARNING: Explosion hazard**

The device should be installed in a housing (control or distributor box) that fulfills the requirements of EN 60079-15 and at least IP54 (EN 60529) degree of protection.



**WARNING: Explosion hazard**

When installing and connecting the supply and signal circuits observe the requirements of EN 60079-14. Only devices suitable for operation in Ex zone 2 and the conditions at the application site may be connected to the circuits in zone 2.



**WARNING: Explosion hazard**

Cables may be connected and disconnected in potentially explosive areas only when power is disconnected.



**WARNING: Explosion hazard**


The device must be stopped and immediately removed from the Ex area if it is damaged or was subject to an impermissible load or stored incorrectly or if it malfunctions.



You can download the latest documents from [www.phoenixcontact.net/download](http://www.phoenixcontact.net/download).

## 6 Structure

- 1 Knurled wheel for setting the time
- 2 LED U/t (green): Supply voltage and adjustable time
- 3 LED R (yellow): Output relay

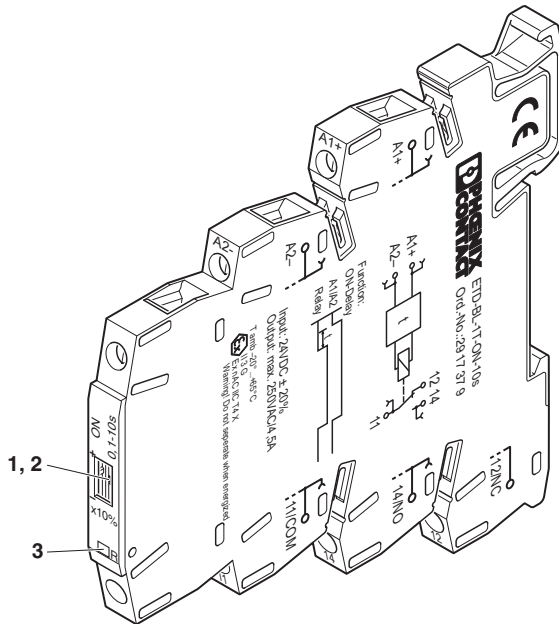

## 7 Installation



### **WARNING: Risk of electric shock**

Never carry out work when voltage is present.


The module can be snapped onto all 35 mm DIN rails according to EN 60715.

UL requirement: Use copper cables approved for at least 75°C.

### **Power supply**

The module is supplied with 24 V of DC voltage.

## 8 Time setting

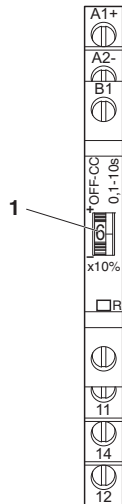

The time can be adjusted variably using a screwdriver (blade width 2.5 mm). The value set on the knurled wheel multiplied by 10 gives the percentage set value of the time end value.

### Example:

Time end range of the time relay = 10 s

1 Setting on the knurled wheel = 6       $6 \times 10 \% = 60 \%$   
 Time end range of the time relay = 10 s     $60 \% \text{ of } 10 \text{ s} = 6 \text{ s}$

According to the setting of the knurled wheel (1...10), you can also read the time directly from the "Time setting for different time setting ranges" table.

### Time settings for various time setting ranges:

| Position<br>Knurled wheel | 0.1 - 10 s<br>time [seconds] | 3 - 300 s<br>time [seconds] | 0.3 - 30 min<br>time [minutes] | 3 - 300 min<br>time [minutes] |
|---------------------------|------------------------------|-----------------------------|--------------------------------|-------------------------------|
| 0                         | 0,1                          | 3                           | 0,3                            | 3                             |
| 1                         | 1                            | 30                          | 3                              | 30                            |
| 2                         | 2                            | 60                          | 6                              | 60                            |
| 3                         | 3                            | 90                          | 9                              | 90                            |
| 4                         | 4                            | 120                         | 12                             | 120                           |
| 5                         | 5                            | 150                         | 15                             | 150                           |
| 6                         | 6                            | 180                         | 18                             | 180                           |
| 7                         | 7                            | 210                         | 21                             | 210                           |
| 8                         | 8                            | 240                         | 24                             | 240                           |
| 9                         | 9                            | 270                         | 27                             | 270                           |
| 10                        | 10                           | 300                         | 30                             | 300                           |



The following table shows some examples: All intermediate values (e. g. 1.5) can be adjusted. The smallest adjustable time is reached at position "0". No time can be set between "10" and "0". This area is identified with a quickly flashing geed LED.

## 9 Diagnostics

The LEDs indicate the following error states:


### LED U/t (green, backlighting of the knurled wheel)

- Flashes: Voltage is present, the set time is elapsing
- Flashing quickly: Undefined time range between "10" and "0" adjusted
- On: Voltage is present, the set time has elapsed

### LED R (yellow)


- On: The output relay has picked up
- Off: The output relay is dropped

## 10 Connection example

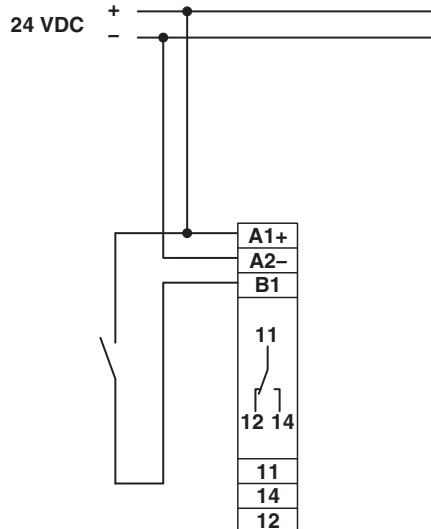

## 11 Function

### OFF-CC: With off delay with control contact

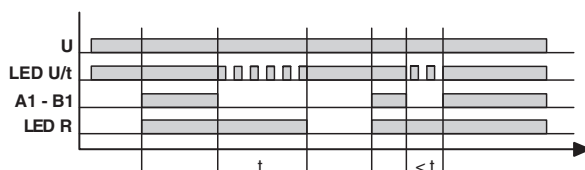

Supply voltage  $U$  must be applied permanently to the device (green LED U/t lights up). When control contact A1-B1 closes, the output relay picks up (yellow LED R lights up). If control contact A1-B1 opens, the set time  $t$  starts running (green LED U/t flashes). After time  $t$  has elapsed (green LED U/t lights up) the output relays drop out (yellow LED R is not lit). If the control contact is closed again before time  $t$  elapses, the elapsed time is deleted and restarted with the next cycle.

Компания «Life Electronics» занимается поставками электронных компонентов импортного и отечественного производства от производителей и со складов крупных дистрибьюторов Европы, Америки и Азии.

С конца 2013 года компания активно расширяет линейку поставок компонентов по направлению коаксиальный кабель, кварцевые генераторы и конденсаторы (керамические, пленочные, электролитические), за счёт заключения дистрибьюторских договоров

Мы предлагаем:

- Конкуренспособные цены и скидки постоянным клиентам.
- Специальные условия для постоянных клиентов.
- Подбор аналогов.
- Поставку компонентов в любых объемах, удовлетворяющих вашим потребностям.
- Приемлемые сроки поставки, возможна ускоренная поставка.
- Доставку товара в любую точку России и стран СНГ.
- Комплексную поставку.
- Работу по проектам и поставку образцов.
- Формирование склада под заказчика.
- Сертификаты соответствия на поставляемую продукцию (по желанию клиента).
- Тестирование поставляемой продукции.
- Поставку компонентов, требующих военную и космическую приемку.
- Входной контроль качества.
- Наличие сертификата ISO.

В составе нашей компании организован Конструкторский отдел, призванный помогать разработчикам, и инженерам.

Конструкторский отдел помогает осуществить:

- Регистрацию проекта у производителя компонентов.
- Техническую поддержку проекта.
- Защиту от снятия компонента с производства.
- Оценку стоимости проекта по компонентам.
- Изготовление тестовой платы монтаж и пусконаладочные работы.



Тел: +7 (812) 336 43 04 (многоканальный)

Email: [org@lifeelectronics.ru](mailto:org@lifeelectronics.ru)